

7SR21 Non-Directional

7SR22 Directional

Overcurrent Relay

Document Release History

This document is issue **2010/05**. The list of revisions up to and including this issue is:

2010/05	Additional Comms module option of (RS485 + IRIG-B) and (RS232 + IRIG-B) and Typographical revisions
2010/02	Document reformat due to rebrand
2009/09	Third Issue. Software revision 2435H8004/5 R4b-4
2008/07	Second Issue. Software revision 2434H80011R3d-2
2008/06	R1a Typographical revisions
2008/03	First issue

Software Revision History

2009/09	2435H8004/5 R4b-4	CTS-I Supervision. Undercurrent 37G & 37SEF. Vx U/O Voltage. 46BC U/C. Comms Settings. Waveform Storage Settings. Fault Storage Settings. Energy Storage. Trip test function. Local/Remote modes. Settings ranges extended. Protocol changes.
2008/07	2434H80011R3d-2	Demand records. Optional DNP3.0 data comms.
2008/03	2435H800004/5R2c-2b	First Release

The copyright and other intellectual property rights in this document, and in any model or article produced from it (and including any registered or unregistered design rights) are the property of Siemens Protection Devices Limited. No part of this document shall be reproduced or modified or stored in another form, in any data retrieval system, without the permission of Siemens Protection Devices Limited, nor shall any model or article be reproduced from this document unless Siemens Protection Devices Limited consent.

While the information and guidance given in this document is believed to be correct, no liability shall be accepted for any loss or damage caused by any error or omission, whether such error or omission is the result of negligence or any other cause. Any and all such liability is disclaimed.

Contents

Section 1: Common Functions	6
1.1 General	6
1.1.1 CE Conformity	6
1.1.2 Reference	6
1.1.3 Dimensions	6
1.1.4 Weights	7
1.2 Energising Quantities	8
1.2.1 Auxiliary Power Supply	8
1.2.2 AC Current	8
1.2.3 AC Voltage	9
1.2.4 Binary (Digital) Outputs	9
1.2.5 Binary (Digital) Inputs	11
1.3 Functional performance	13
1.3.1 Instrumentation	13
1.3.2 USB Data Communication Interface	13
1.3.3 Fibre optic Data Communication Interface (Optional Rear Mounted Port)	13
1.3.4 RS485 Data Communication Interface (Standard Rear Port)	13
1.3.5 RS485 Data Communication Interface (Optional Rear Mounted Port)	13
1.3.6 RS232 Data Communication Interface (Optional Rear Mounted Port)	13
1.3.7 Real Time Clock	14
1.4 Environmental Performance	15
1.4.1 General	15
1.4.2 Emissions	15
1.4.3 Immunity	16
1.4.4 Mechanical	17
Section 2: Protection Functions	18
2.1 27/59 Phase Under/over voltage	18
2.1.1 Reference	18
2.1.2 Operate and Reset Level	18
2.1.3 Operate and Reset Time	18
2.2 27/59 Vx Under/over voltage	19
2.2.1 Reference	19
2.2.2 Operate and Reset Level	19
2.2.3 Operate and Reset Time	19
2.3 37 Undercurrent	20
2.3.1 Reference	20
2.3.2 Operate and Reset Level	20
2.3.3 Operate and Reset Time	20
2.4 37G & 37SEF Undercurrent	21
2.4.1 Reference	21
2.4.2 Operate and Reset Level	21
2.4.3 Operate and Reset Time	21
2.5 46NPS Negative phase sequence overcurrent	22
2.5.1 Reference (46DT)	22
2.5.2 Operate and Reset Level (46DT)	22
2.5.3 Operate and Reset Time (46DT)	22
2.5.4 Reference (46IT)	22
2.5.5 Operate and Reset Level (46IT)	23
2.5.6 Operate and Reset Time (46IT)	23
2.6 47 Negative phase sequence voltage	24
2.6.1 Reference (47)	24
2.6.2 Operate and Reset Level (47)	24
2.6.3 Operate and Reset Time (47)	24
2.7 49 Thermal overload	25
2.7.1 Reference	25

2.7.2	Operate and Reset Level	25
2.7.3	Operate and Reset Time	25
2.8	50 Instantaneous Overcurrent	27
2.8.1	Reference	27
2.8.2	Operate and Reset Level	27
2.8.3	Operate and Reset Time	27
2.9	50G Instantaneous Measured Earth Fault	28
2.9.1	Reference	28
2.9.2	Operate and Reset Level	28
2.9.3	Operate and Reset Time	28
2.10	50N instantaneous Derived Earth Fault	29
2.10.1	Reference	29
2.10.2	Operate and Reset Level	29
2.10.3	Operate and Reset Time	29
2.11	50SEF Instantaneous Sensitive Earth Fault	30
2.11.1	Reference	30
2.11.2	Operate and Reset Level	30
2.11.3	Operate and Reset Time	30
2.12	51 Time Delayed Overcurrent	31
2.12.1	Reference	31
2.12.2	Operate and Reset Level	31
2.12.3	Operate and Reset Time	32
2.13	51G Time Delayed Measured Earth Fault	36
2.13.1	Reference	36
2.13.2	Operate and Reset Level	36
2.13.3	Operate and Reset Time	37
2.14	51N Time Delayed Derived Earth Fault	38
2.14.1	Reference	38
2.14.2	Operate and Reset Level	38
2.14.3	Operate and Reset Time	39
2.15	51SEF Time Delayed Sensitive Earth Fault	40
2.15.1	Reference	40
2.15.2	Operate and Reset Level	40
2.15.3	Operate and Reset Time	41
2.16	51V voltage controlled overcurrent (Ph-Ph)	42
2.16.1	Reference	42
2.16.2	Operate and Reset Level	42
2.17	59N Neutral Voltage Displacement	43
2.17.1	Reference (59NDT)	43
2.17.2	Operate and Reset Level (59NDT)	43
2.17.3	Operate and Reset Time (59NDT)	43
2.17.4	Reference (59NIT)	43
2.17.5	Operate and Reset Level (59NIT)	44
2.17.6	Operate and Reset Time (59NIT)	44
2.18	64H Restricted Earth Fault Protection	45
2.18.1	Reference	45
2.18.2	Operate and Reset Level	45
2.18.3	Operate and Reset Time	45
2.19	67/67N directional overcurrent & earth fault	46
2.19.1	Reference	46
2.19.2	Operate Angle	46
2.19.3	Operate Threshold	46
2.19.4	Operate and Reset Time	46
2.20	81 Under/over frequency	47
2.20.1	Reference	47
2.20.2	Operate and Reset Level	47
2.20.3	Operate and Reset Time	47

Section 3: Supervision Functions	48
3.1 46BC & 46BC U/C broken conductor	48
3.1.1 Reference.....	48
3.1.2 Operate and Reset Level	48
3.1.3 Operate and Reset Time.....	48
3.2 50BF & 50BF-I4 circuit breaker fail	49
3.2.1 Reference.....	49
3.2.2 Operate and Reset Level	49
3.2.3 Operate and Reset Time.....	49
3.3 60CTS & CTS-I Current Transformer Supervision	50
3.3.1 Reference.....	50
3.3.2 Current & Voltage Threshold.....	50
3.3.3 Operate and Reset Time.....	50
3.4 60VTS Voltage Transformer Supervision	51
3.4.1 Reference.....	51
3.4.2 Operate and Reset Level	51
3.4.3 Operate and Reset Time.....	52
3.5 74TCS Trip Circuit Supervision.....	53
3.5.1 Reference.....	53
3.5.2 Operate and Reset Time.....	53
3.6 81HBL2 Inrush Detector	54
3.6.1 Reference.....	54
3.6.2 Operate and Reset Level	54
3.6.3 Operate and Reset Time.....	54

List of Figures

Figure 1-1	Binary Input Configurations Providing Compliance with EATS 48-4 Classes ESI 1 and ESI 2	12
Figure 2-1	Thermal Overload Protection Curves	26
Figure 2-2	IEC IDMTL Curves (Time Multiplier=1).....	33
Figure 2-3	ANSI IDMTL Operate Curves (Time Multiplier=1)	34
Figure 2-4	ANSI IDMTL Operate Curves (Time Multiplier=1)	35

Section 1: Common Functions

1.1 General

1.1.1 CE Conformity

CE This product is CE compliant to relevant EU directives.

1.1.2 Reference

This product complies with IEC 60255-3, IEC 60255-6 and IEC 60255-12.

1.1.2.1 Accuracy Reference Conditions

This product has been tested under the following conditions, unless specifically stated otherwise.

Parameter	Value
Auxiliary supply	nominal
Frequency	nominal
Ambient temperature	20 °C

1.1.3 Dimensions

Parameter	Value	
Width	E6 case	155.5 mm
	E8 case	207.5 mm
Height	177 mm	
Depth behind panel (including clearance for wiring and fibre)	286.5 mm	
Projection (from front of panel)	31 mm	

See appropriate case outline and panel drilling drawing, as specified in Diagrams and Parameters document, for complete dimensional specifications.

1.1.4 Weights

Parameter		Value
Net weight	7SR2102, E6 case	3.3 kg
	7SR2103, E8 case	4.6 kg
	7SR2104, E8 case	4.8 kg
	7SR2202, E6 case	4.8 kg
	7SR2203, E8 case	4.9 kg
	7SR2204, E8 case	5.0 kg

NB: If supplied with communication interface devices please add an additional 0.165 kg

Energising Quantities

1.1.5 Auxiliary Power Supply

Nominal		Operating Range
V_{AUX}	30, 48, 110, 220 VDC	24 to 290 VDC

1.1.5.1 Burden

Attribute		Value
30V DC	Quiescent (typical)	6.0 W
	Quiescent (back light)	7.0 W
48V DC	Quiescent (typical)	5.5W
	Quiescent (back light)	6.5W
110V DC	Quiescent (typical)	6.5W
	Quiescent (back light)	7.5W
220V DC	Quiescent (typical)	7.5W
	Quiescent (back light)	8.5W

1.1.5.2 Operational Features

Attribute	Value	Comments
0% Dip Withstand Period	100ms	
Dip Immunity Acquisition Period	5minutes	Typical time after switch on to attain claimed immunity to dips
<p>NOTE: -</p> <p>Dips in supply that fall below the minimum voltage for a period greater than the 0% Dip Withstand Period, will invoke a relay reset.</p> <p>During conditions of auxiliary input voltage variations which are not described⁽¹⁾ in section 1.4.3.1, the relay may enter a safety protection mode where a power supply shutdown occurs. This condition is designed to protect the power supply from damage as well as prevent internal relay faults from developing into dangerous situations.</p> <p>Once the relay has entered this safety mode, it may be necessary to reduce the auxiliary input voltage to zero volts for up to 30 seconds before re-application of the auxiliary supply will cause the relay to power up and operate normally.</p> <p>(1) Using fuses as on/off switches or allowing batteries to run at very low cell voltages for extended periods and then attempting to re-charge them are examples of such auxiliary supply conditions.</p>		

1.1.6 AC Current

Nominal		Measuring Range
I_n	1, 5 A Phase and earth	80 x I_n
f_n	50, 60Hz	47 to 62Hz

Note. 1A and 5A nominal inputs are user selectable on each model.

1.1.6.1 Burden

Attribute	Value - Phase and Earth	
	1A	5A
AC Burden	≤ 0.1 VA	≤ 0.3 VA

1.1.6.2 Thermal Withstand

Overload Period	Overload Current	
	Phase and Earth	
	1A	5A
Continuous	3.0 xI_n	
10 minutes	3.5 xI_n	
5 minutes	4.0 xI_n	
3 minutes	5.0 xI_n	
2 minutes	6.0 xI_n	
3 seconds	57.7A	202A
2 seconds	70.7A	247A
1 second	100A	350A
1 cycle	700A	2500A

1.1.7 AC Voltage

Nominal		Operating Range
V_n	63.5V, 110 V	270 V
f_n	50, 60Hz	47 to 62Hz

1.1.7.1 Burden

Attribute	Value
AC Burden	≤ 0.1 VA at 110 V

1.1.8 Binary (Digital) Outputs

Contact rating to IEC 60255-0-2

Attribute		Value
Carry continuously		5A AC or DC
Make and carry (L/R ≤ 40 ms and V ≤ 300 V)	for 0.5 s	20A AC or DC
	for 0.2 s	30A AC or DC
Break (≤ 5 A and ≤ 300 V)	AC resistive	1250 VA
	AC inductive	250 VA at p.f. ≤ 0.4
	DC resistive	75 W
	DC inductive	30 W at L/R ≤ 40ms 50 W at L/R ≤ 10ms

Attribute	Value
Contact Operate / Release Time	7ms / 3ms
Minimum number of operations	1000 at maximum load
Minimum recommended load	0.5 W at minimum of 10mA or 5V

1.1.9 Binary (Digital) Inputs

Nominal		Operating Range
V_{BI}	19 VDC	17 to 290 VDC
	88 VDC	74 to 290 VDC


1.1.9.1 Performance

Attribute		Value
Maximum DC current for operation	$V_{BI} = 19\text{ V}$	1.5mA
	$V_{BI} = 88\text{ V}$	1.5mA
Reset/Operate voltage ratio		$\geq 90\%$
Response time		$< 7\text{ms}$
Response time when programmed to energise an output relay contact (i.e. includes output relay operation)		$< 20\text{ms}$

The binary inputs have a low minimum operate current and may be set for high speed operation. Where a binary input is both used to influence a control function (e.g. provide a tripping function) and it is considered to be susceptible to mal-operation due to capacitive currents, the external circuitry can be modified to provide immunity to such disturbances.

To comply with EATS 48-4, classes ESI 1 and ESI 2, external components / BI pick-up delays are required as shown in fig. 1-1.

To achieve immunity from AC interference, a BI pick-up delay of typically one-cycle can be applied.

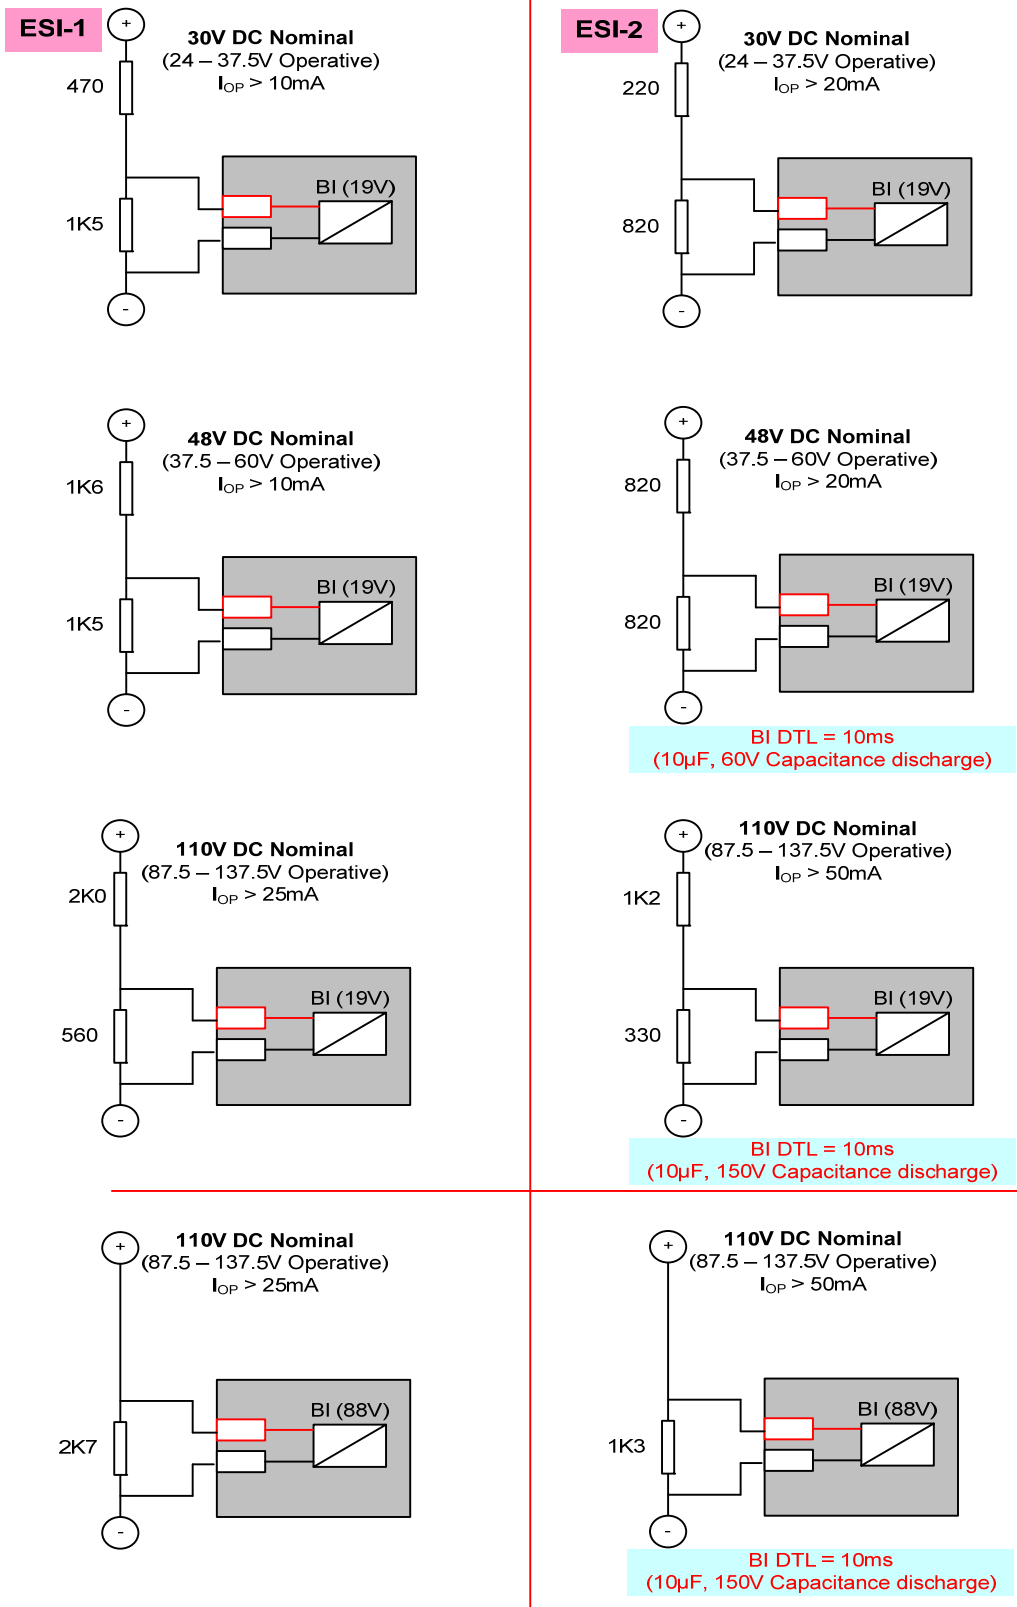

Resistor power ratings:

- 30V DC Nominal >3W
- 48V DC Nominal >3W
- 110V DC Nominal >10W (ESI-1)
- 110V DC Nominal >20W (ESI-2)

Resistors must be wired with crimped connections as they may run hot

Figure 1-1 Binary Input Configurations Providing Compliance with EATS 48-4 Classes ESI 1 and ESI 2

1.2 Functional performance

1.2.1 Instrumentation

	Instrument Value	Reference	Typical accuracy
I	Current	$I \geq 0.1 \times I_n$	$\pm 1 \% I_n$
V	Voltage	$V \geq 0.8 \times V_n$	$\pm 1 \% V_n$
	Power, real and apparent	$V = V_n, I \geq 0.1 \times I_n, pf \geq 0.8$	$\pm 3\% P_n$, where $P_n = V_n \times I_n$
pf	Power factor	$V = V_n, I \geq 0.1 \times I_n, pf \geq 0.8$	± 0.05

1.2.2 USB Data Communication Interface

Attribute	Value
Physical layer	Electrical
Connectors	USB-Type B

1.2.3 Fibre optic Data Communication Interface (Optional Rear Mounted Port)

Attribute	Value
Physical layer	Fibre-optic
Connectors	ST TM (BFOC/2.5)
Recommended fibre	62.5/125 μ m glass fibre with ST connector
Launch power (into recommended fibre)	-16 dBm
Receiver sensitivity	-24 dBm

1.2.4 RS485 Data Communication Interface (Standard Rear Port)

Attribute	Value
Physical layer	Electrical
Connectors	4mm Ring Crimp

1.2.5 RS485 Data Communication Interface (Optional Rear Mounted Port)

Attribute	Value
Physical layer	Electrical
Connectors	4-way Plug

1.2.6 RS232 Data Communication Interface (Optional Rear Mounted Port)

Attribute	Value
Physical layer	Electrical
Connectors	9-way D-plug

1.2.7 Real Time Clock

1.2.7.1 Internal Clock

The specification below applies only while no external synchronisation signal (e.g. IRIG-B, IEC 60870-5-103) is being received.

Attribute	Value
Accuracy (-10 to +55°C)	± 3.5 ppm (No Aux supply connected)
	± 100 ppm (Aux supply connected)

1.2.7.2 IRIG-B

Attribute	Value
Connector	BNC
Signal Type	IRIG-B 120, 122 or 123
Applied signal level	minimum 3 V, maximum 6 V, peak-to-peak
Signal : carrier ratio	3:1

1.3 Environmental Performance

1.3.1 General

1.3.1.1 Temperature

IEC 60068-2-1/2

Type	Level
Operating range	-10 °C to +55 °C
Storage range	-25 °C to +70 °C

1.3.1.2 Humidity

IEC 60068-2-3

Type	Level
Operational test	56 days at 40 °C and 95 % relative humidity

1.3.1.3 Transient Overvoltage

IEC 60255-5

Type	Level
Between all terminals and earth, or between any two independent circuits	5.0 kV, 1.2/50 μ s 0.5j

1.3.1.4 Insulation

IEC 60255-5

Type	Level
Between any terminal and earth	2.0 kV AC RMS for 1 min
Between independent circuits	
Across normally open contacts	1.0 kV AC RMS for 1 min

1.3.1.5 IP Ratings

Type	Level
Installed with cover on	IP 50 from front of relay
Installed with cover removed	IP 30 from front of relay

1.3.2 Emissions

IEC 60255-25

1.3.2.1 Radiated Radio Frequency

Type	Limits at 10 m, Quasi-peak
30 to 230 MHz	40 dB(μ V/m)
230 to 10000 MHz	47 dB(μ V/m)

1.3.2.2 Conducted Radio Frequency

Type	Limits	
	Quasi-peak	Average
0.15 to 0.5 MHz	79 dB(μ V)	66 dB(μ V)
0.5 to 30 MHz	73 dB(μ V)	60 dB(μ V)

1.3.3 Immunity

1.3.3.1 Auxiliary DC Supply Variation

Quantity	Value
Allowable superimposed ac component	\leq 12% of DC voltage
Allowable breaks/dips in supply (collapse to zero from nominal voltage)	\leq 20ms

1.3.3.2 High Frequency Disturbance

IEC 60255-22-1 Class III

Type	Level	Variation
Common (longitudinal) mode	2.5 kV	\leq 5 %
Series (transverse) mode	1.0 kV	

1.3.3.3 Electrostatic Discharge

IEC 60255-22-2 Class IV

Type	Level	Variation
Contact discharge	8.0 kV	\leq 5 %

1.3.3.4 Radiated Immunity

IEC 60255-22-3 Class III

Type	Level	Variation
80 MHz to 1000 MHz	10 V/m	\leq 5 %

1.3.3.5 Fast Transients

IEC 60255-22-4 Class IV

Type	Level	Variation
5/50 ns 2.5 kHz repetitive	4kV	\leq 5 %

1.3.3.6 Surge Immunity

IEC 60255-22-5

Type	Level	Variation
Between all terminals and earth	4.0 kV	\leq 10 % or 1mA
Between Line to Line	2.0 kV	

1.3.3.7 Conducted Radio Frequency Interference

IEC 60255-22-6

Type	Level	Variation
0.15 to 80 MHz	10 V	≤ 5 %

1.3.3.8 Magnetic Field with Power Frequency

IEC 61000-4-8 level 5

100A/m, (0.126mT) continuous	50Hz
1000A/m, (1.26mT) for 3s	

1.3.4 Mechanical

1.3.4.1 Vibration (Sinusoidal)

IEC 60255-21-1 Class I

Type	Level	Variation
Vibration response	0.5 gn	≤ 5 %
Vibration endurance	1.0 gn	

1.3.4.2 Shock and Bump

IEC 60255-21-2 Class I

Type	Level	Variation
Shock response	5 gn, 11 ms	≤ 5 %
Shock withstand	15 gn, 11 ms	
Bump test	10 gn, 16 ms	

1.3.4.3 Seismic

IEC 60255-21-3 Class I

Type	Level	Variation
Seismic response	1 gn	≤ 5 %

1.3.4.4 Mechanical Classification

Type	Level
Durability	> 10 ⁶ operations

Section 2: Protection Functions

2.1 27/59 Phase Under/over voltage

2.1.2 Reference

	Parameter	Value
V_s	Setting	5, 5.5...199.5, 200V
$hyst$	Hysteresis setting	0, 0.1... 80.0%
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.1.3 Operate and Reset Level

	Attribute	Value
V_{op}	Operate level	100 % V_s , $\pm 1\%$ or $\pm 0.25V$
	Reset level	Overvoltage = $(100\% - hyst) \times V_{op}$, $\pm 1\%$ or $\pm 0.25V$
		Undervoltage = $(100\% + hyst) \times V_{op}$, $\pm 1\%$ or $\pm 0.25V$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C $\leq 5\%$
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$ $\leq 5\%$

2.1.4 Operate and Reset Time

	Attribute	Value
t_{basicE}	Element basic operate time	Overvoltage
		0 to 1.1 x V_s : 73 ms $\pm 10\text{ms}$
	Undervoltage	0 to 2.0 x V_s : 63 ms $\pm 10\text{ms}$
		1.1 to 0.5 x V_s : 58 ms $\pm 10\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Disengaging time	< 80 ms

2.2 27/59 Vx Under/over voltage

2.2.1 Reference

	Parameter	Value
V_s	Setting	5, 5.5...199.5, 200V
V_s <i>Guard</i>	Guard Setting	1, 1.5, ...199.5, 200V
<i>hyst</i>	Hysteresis setting	0, 0.1... 80.0%
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.2.2 Operate and Reset Level

	Attribute	Value
V_{op}	Operate level	100 % V_s , ± 1 % or $\pm 0.25V$
	Reset level	Overvoltage = $(100 \% - hyst) \times V_{op}$, ± 1 % or $\pm 0.25V$
		Undervoltage = $(100 \% + hyst) \times V_{op}$, ± 1 % or $\pm 0.25V$
	Repeatability	± 1 %
	Variation	-10 °C to +55 °C ≤ 5 %
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz ≤ 5 %

2.2.3 Operate and Reset Time

	Attribute	Value
t_{basicE}	Element basic operate time	Overvoltage
		0 to 1.1 x V_s : 73 ms ± 10 ms
		0 to 2.0 x V_s : 63 ms ± 10 ms
	Undervoltage	1.1 to 0.5 x V_s : 58 ms ± 10 ms
t_{op}	Operate time following delay	$t_{basic} + t_d$, ± 1 % or ± 10 ms
	Repeatability	± 1 % or ± 10 ms
	Disengaging time	< 80 ms

2.3 37 Undercurrent

2.3.1 Reference

	Parameter	Value
I_s	Setting	0.05, 0.10...5.0 x/n
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.3.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\%$ I_n
	Reset level	$\leq 105\%$ I_{op}
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz
		$\leq 5\%$
		$\leq 5\%$

2.3.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	1.1 to 0.5 x/s : 35 ms, ± 10 ms
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or ± 10 ms
	Repeatability	$\pm 1\%$ or ± 10 ms
	Overshoot time	< 40 ms
	Disengaging time	< 60 ms

2.4 37G & 37SEF Undercurrent

2.4.1 Reference

	Parameter	Value
I_s	Setting	0.005, 0.10...5.0 $x I_n$
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.4.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\% I_n$
	Reset level	$\leq 105\% I_{op}$ or $I_{op} \pm 0.1\% I_n$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.4.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	1.1 to 0.5 $x I_s$: 35 ms, $\pm 10\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 60\text{ ms}$

2.5 46NPS Negative phase sequence overcurrent

2.5.1 Reference (46DT)

	Parameter	Value
I_s	Setting	0.05, 0.06... 4.0xIn
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.5.2 Operate and Reset Level (46DT)

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\%$ I_n
	Reset level	$\geq 95\%$ I_{op}
	Repeatability	$\pm 1\%$
	Transient overreach (X/R ≤ 100)	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz
		$\leq 5\%$
		$\leq 5\%$

2.5.3 Operate and Reset Time (46DT)

	Attribute	Value
t_{basic}	Element basic operate time	0 to 2 xIs: 40 ms, ± 10 ms
		0 to 5 xIs: 30 ms, ± 10 ms
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or ± 10 ms
	Repeatability	$\pm 1\%$ or ± 10 ms
	Overshoot time	<40 ms
	Disengaging time	< 60 ms

2.5.4 Reference (46IT)

	Parameter	Value
<i>char</i>	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL
<i>Tm</i>	Time Multiplier setting	0.025, 0.050 ... 1.6
I_s	Setting	0.05, 0.06... 2.5xIn
<i>I</i>	Applied Current (for operate time) IDMTL	2 to 20 x Is
t_d	Delay setting	0, 0.01... 20 s
t_{res}	Reset setting	ANSI DECAYING, 0, 1... 60 s

2.5.5 Operate and Reset Level (46IT)

	Attribute	Value
I_{op}	Operate level	105 % I_s , ± 4 % or ± 1 % I_n
	Reset level	(100%-Hyst.) $\times V_{op} \pm 1$ % or $\pm 0.25V$
	Repeatability	± 1 %
	Variation	-10 °C to +55 °C
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz
		≤ 5 %
		≤ 5 %

2.5.6 Operate and Reset Time (46IT)

	Attribute	Value
	Starter operate time ($\geq 2xI_s$)	35 ms, ± 10 ms
t_{op}	Operate time	$char = IEC-NI, IEC-VI, IEC-EI, IEC-LTI$ $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5 \text{ % absolute or } \pm 50 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$char = ANSI-MI, ANSI-VI, ANSI-EI$ $t_{op} = \left[\frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5 \text{ % absolute or } \pm 50 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	$char = DTL$	$t_d, \pm 1$ % or ± 20 ms
	Reset time	$ANSI$ DECAYING $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5 \text{ % absolute or } \pm 50 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
	t_{res}	$t_{res}, \pm 1$ % or ± 20 ms
	Repeatability	± 1 % or ± 20 ms
	Overshoot time	< 40 ms
	Disengaging time	< 60 ms

2.6 47 Negative phase sequence voltage

2.6.1 Reference (47)

	Parameter	Value
V_s	Setting	1, 1.5... 90V
<i>Hyst.</i>	Hysteresis	0, 0.1... 80%
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.6.2 Operate and Reset Level (47)

	Attribute	Value
V_{op}	Operate level	100 % V_s , $\pm 2\%$ or $\pm 0.5\text{ V}$
	Reset level	$(100\% - \text{Hyst.}) \times V_{op} \pm 1\%$ or $\pm 0.25\text{V}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.6.3 Operate and Reset Time (47)

	Attribute	Value
t_{basic}	Element basic operate time	0V to 2 x V_s , 80 ms, $\pm 20\text{ms}$
		0V to 10 x V_s , 55 ms, $\pm 20\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 2\%$ or $\pm 20\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 60 ms

2.7 49 Thermal overload

2.7.1 Reference

	Parameter	Value
I_s	Overload setting	0.10, 0.11... 3 $\times I_n$
τ	Time constant setting	1, 1.5... 1000 min

2.7.2 Operate and Reset Level

	Attribute	Value
I_{ol}	Overload level	100 % I_s , $\pm 5\%$ or $\pm 1\% I_n$
	Reset level	$\geq 95\% I_{ol}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.7.3 Operate and Reset Time

	Attribute	Value
t_{op}	Overload trip operate time	$t = \tau \times \ln \left\{ \frac{I^2 - I_p^2}{I^2 - (k \times I_B)^2} \right\}$, $\pm 5\%$ absolute or $\pm 100\text{ms}$, where I_p = prior current
	Repeatability	$\pm 100\text{ms}$

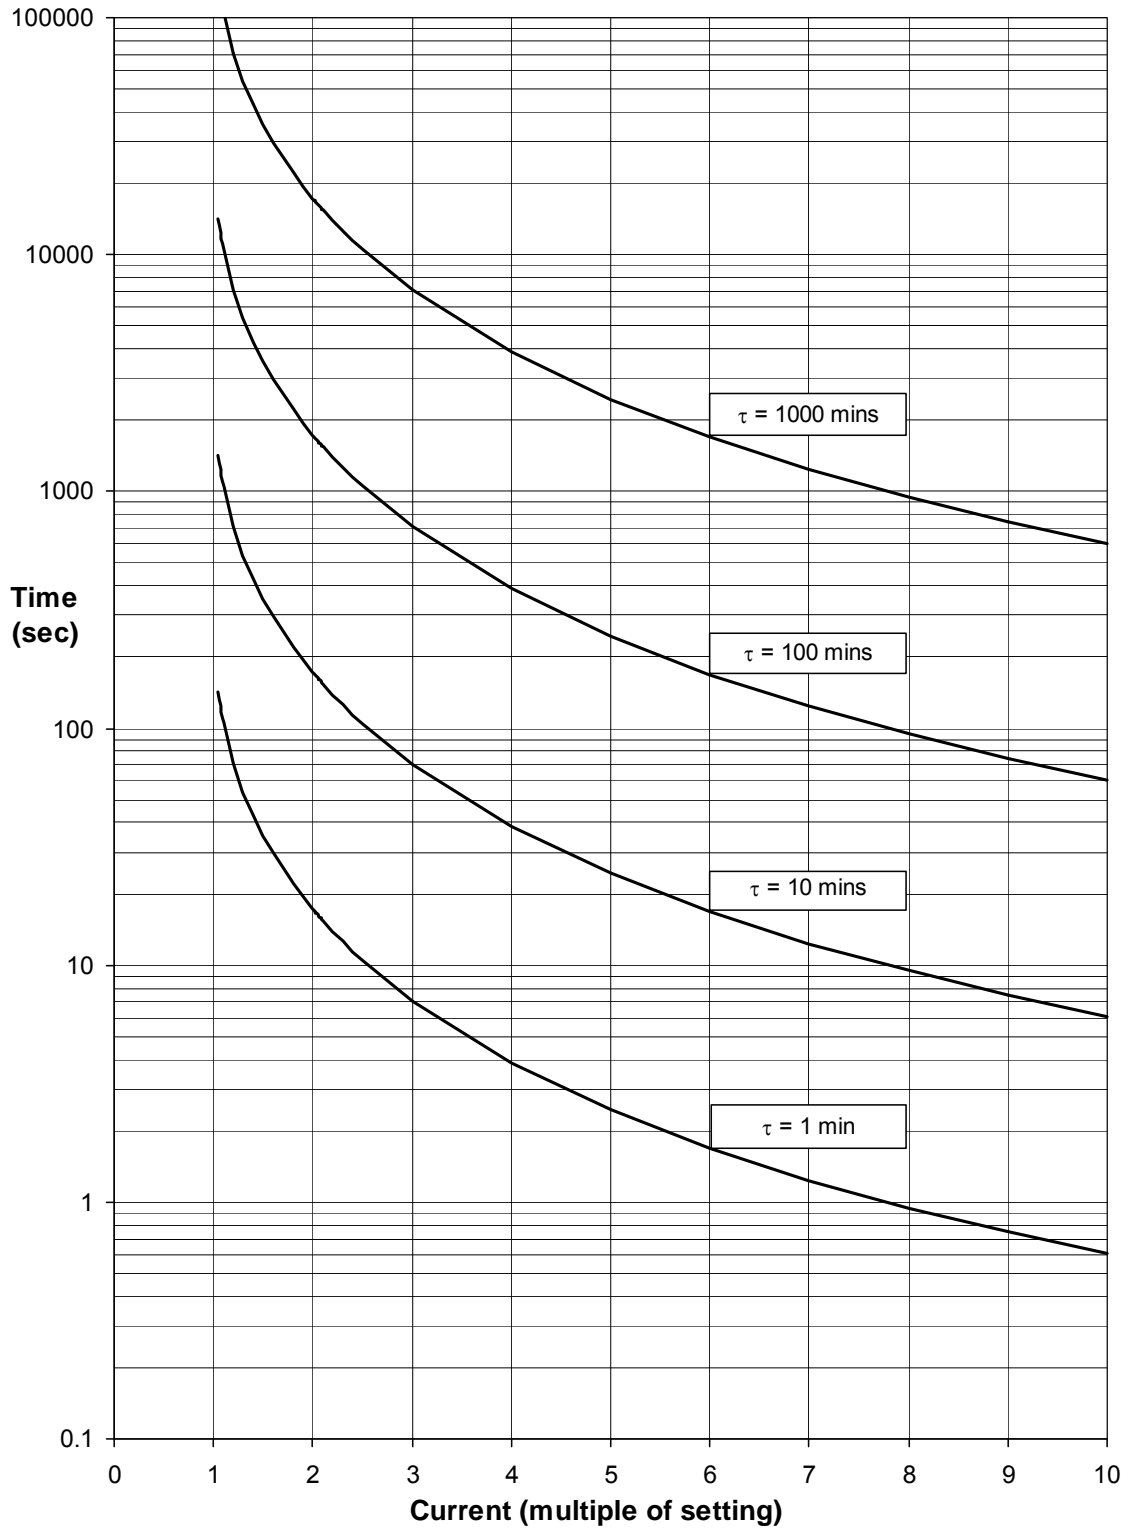


Figure 2-1 Thermal Overload Protection Curves

2.8 50 Instantaneous Overcurrent

2.8.1 Reference

	Parameter	Value
I_s	Setting	0.05, 0.06... 25, 25.5... 50 xIn
i	Applied Current (for operate time)	2 to 5 x Is
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.8.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\%$ I_n
	Reset level	$\geq 95\%$ I_{op}
	Repeatability	$\pm 1\%$
	Transient overreach ($X/R \leq 100$)	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.8.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	0 to 2 xIs: 35 ms, $\pm 10\text{ms}$
		0 to 5 xIs: 25 ms, $\pm 10\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 50\text{ ms}$

2.9 50G Instantaneous Measured Earth Fault

2.9.1 Reference

	Parameter	Value
I_s	Setting	0.005, 0.006... 25 xIn
i	Applied Current (for operate time)	2 to 5 x Is
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.9.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\% I_n$
	Reset level	$\geq 95\% I_{op}$
	Repeatability	$\pm 1\%$
	Transient overreach (X/R ≤ 100)	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.9.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	0 to 2 xIs: 35 ms, $\pm 10\text{ms}$
		0 to 5 xIs: 25 ms, $\pm 10\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 50\text{ ms}$

2.10 50N instantaneous Derived Earth Fault

2.10.1 Reference

	Parameter	Value
I_s	Setting	0.05, 0.06... 25, 25.5... 50 $\times I_n$
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.10.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\% I_n$
	Reset level	$\geq 95\% I_{op}$
	Repeatability	$\pm 1\%$
	Transient overreach ($X/R \leq 100$)	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.10.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	0 to 2 $\times I_s$: 35 ms, $\pm 10\text{ms}$
		0 to 5 $\times I_s$: 25 ms, $\pm 10\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 50\text{ ms}$

2.11 50SEF Instantaneous Sensitive Earth Fault

2.11.1 Reference

	Parameter	Value
I_s	Setting	0.005, 0.006... 5.0 xIn
t_d	Delay setting	0.00, 0.01... 20.0, 20.1 .. 100.0, 101....1000, 1010 ... 10000 , 10100 ... 14400
I	Applied current (for operate time)	5 xIs

2.11.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % Is, ± 5 % or ± 1% In
	Reset level	95 % I _{op} ± 5 % or ± 0.1% In
	Repeatability	± 1 %
	Transient overreach (X/R ≤ 100)	≤ -5 %
	Variation	-10 °C to +55 °C
		$f_{nom} - 3 \text{ Hz to } f_{nom} + 2 \text{ Hz}$
		harmonics to f_{cutoff}
		≤ 5 %
		≤ 5 %

2.11.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	0 to 2 xIs: 35 ms, ± 10ms
		0 to 5 xIs: 25 ms, ± 10ms
t_{op}	Operate time following delay	$t_{basic} + t_d$, ± 1 % or ± 10ms
	Repeatability	± 1 % or ± 10ms
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms
	Variation	$f_{nom} - 3 \text{ Hz to } f_{nom} + 2 \text{ Hz}$
		≤ 5 %

2.12 51 Time Delayed Overcurrent

2.12.1 Reference

	Parameter	Value	
I_s	Setting	0.05, 0.06... 2.5 $x I_n$	
$char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL	
T_m	Time Multiplier setting	0.025, 0.05... 1.6	
t_d	Delay setting	0, 0.01... 20 s	
t_{res}	Reset setting	ANSI DECAIVING, 0, 1... 60 s	
I	Applied Current (for operate time)	IDMTL	2 to 20 x I_s
		DTL	5 x I_s

2.12.2 Operate and Reset Level

	Attribute	Value	
I_{op}	Operate level	105 % I_s , ± 4 % or ± 1 % I_n	
	Reset level	≥ 95 % I_{op}	
	Repeatability	± 1 %	
	Variation	-10 °C to +55 °C	≤ 5 %
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz	≤ 5 %

2.12.3 Operate and Reset Time

Attribute		Value
Starter operate time ($\geq 2xI_s$)		20 ms, ± 20 ms
t_{op}	Operate time	$char = IEC-NI, IEC-VI, IEC-EI, IEC-LTI$ $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$char = ANSI-MI, ANSI-VI, ANSI-EI$ $t_{op} = \left[\frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	$char = DTL$	$t_d, \pm 1\% \text{ or } \pm 20\text{ms}$
Reset time	ANSI DECAIVING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
	t_{res}	$t_{res}, \pm 1\% \text{ or } \pm 20\text{ms}$
Repeatability		$\pm 1\% \text{ or } \pm 20\text{ms}$
Overshoot time		< 40 ms
Disengaging time		< 50 ms

Fig. 2.2 shows the operate times for the four IEC IDMTL curves with a time multiplier of 1.

Figs 2.3 and 2.4 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

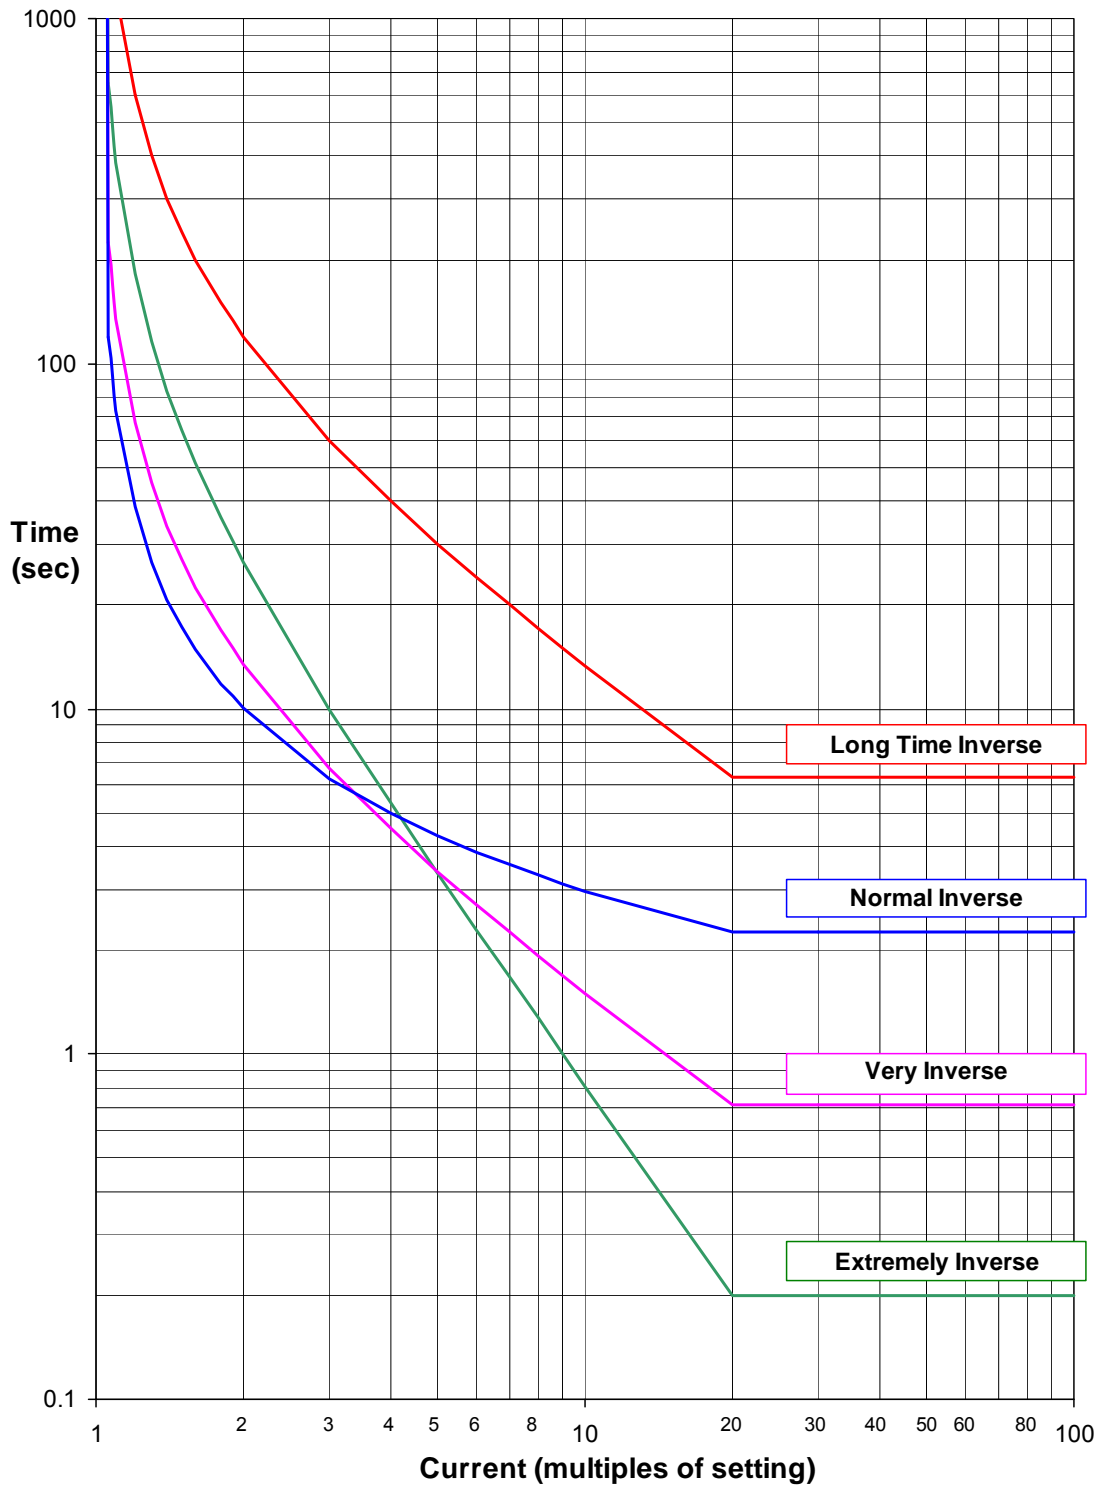


Figure 2-2 IEC IDMTL Curves (Time Multiplier=1)

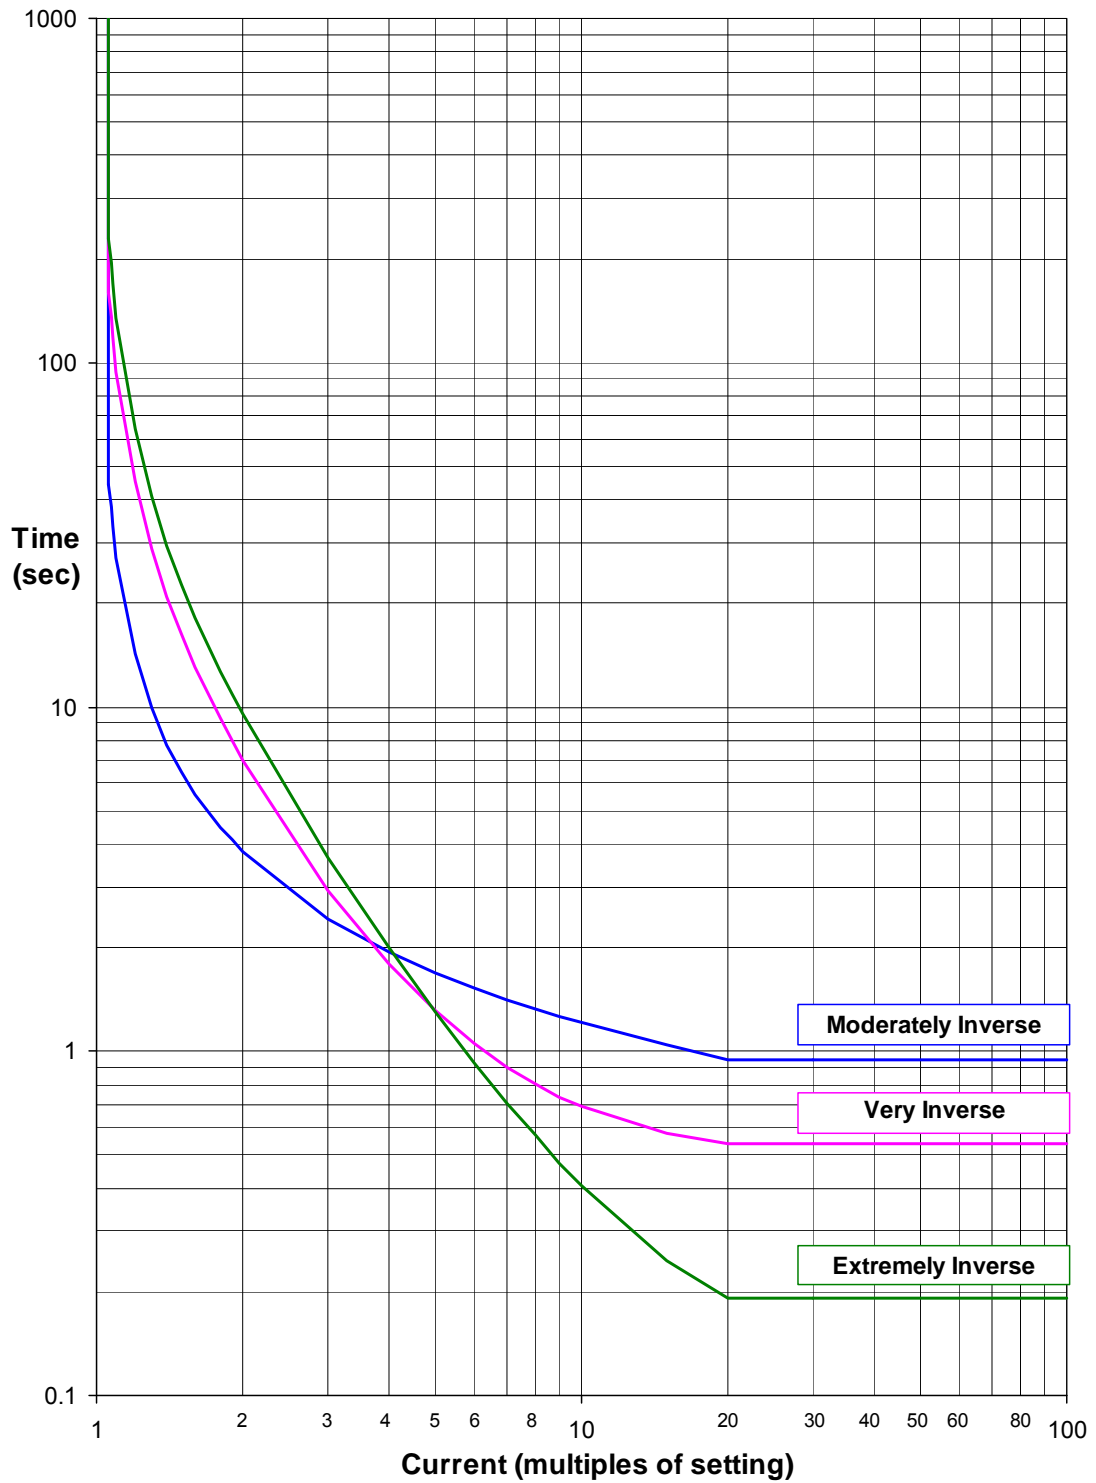


Figure 2-3 ANSI IDMTL Operate Curves (Time Multiplier=1)

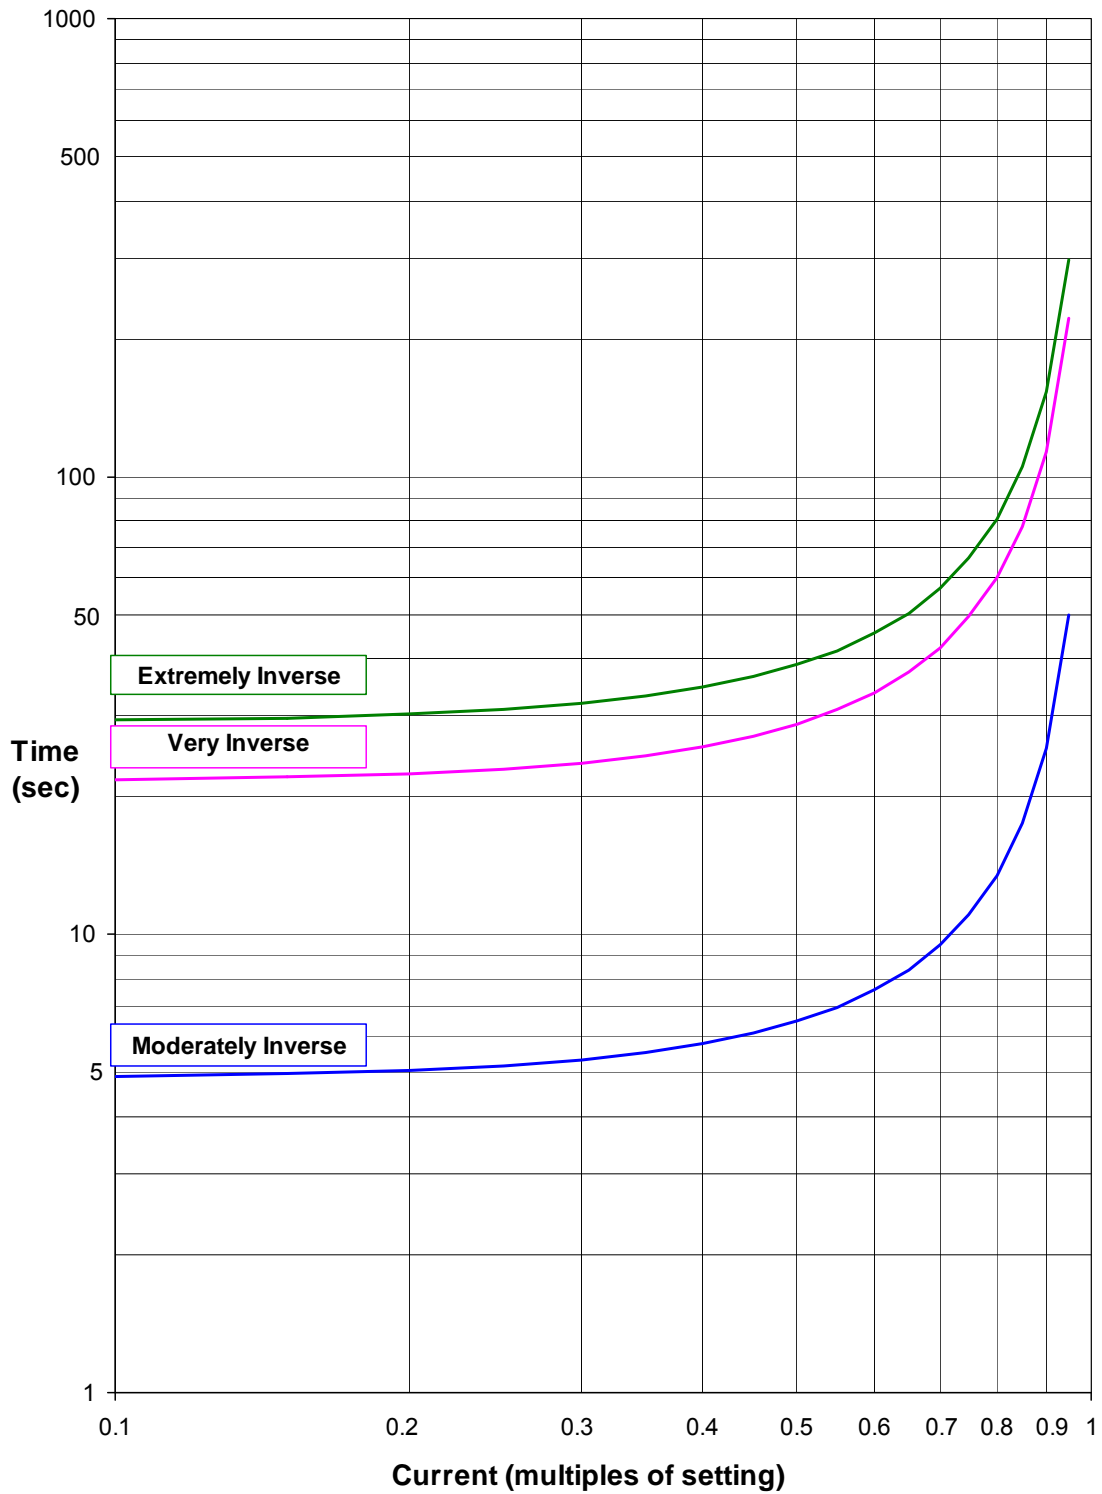


Figure 2-4 ANSI IDMTL Operate Curves (Time Multiplier=1)

2.13 51G Time Delayed Measured Earth Fault

2.13.1 Reference

	Parameter	Value	
I_s	Setting	0.005, 0.006... 1.0 $x I_n$	
$Char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL	
T_m	Time Multiplier setting	0.025, 0.05... 1.6	
t_d	Delay setting (DTL)	0, 0.01... 20 s	
t_{res}	Reset setting	ANSI DECAYING, 0, 1... 60 s	
I	Applied current (for operate time)	IDMTL	2 to 20 $x I_s$
		DTL	5 $x I_s$

2.13.2 Operate and Reset Level

	Attribute	Value	
I_{op}	Operate level	105 % I_s , ± 4 % or ± 1 % I_n	
	Reset level	≥ 95 % I_{op}	
	Repeatability	± 1 %	
	Variation	-10 °C to +55 °C	≤ 5 %
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz	≤ 5 %

2.13.3 Operate and Reset Time

Attribute		Value
Starter operate time ($\geq 2xI_s$)		20 ms, ± 20 ms
t_{op}	Operate time	$t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$t_{op} = \left[\frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	char = DTL	$t_d, \pm 1\% \text{ or } \pm 20$ ms
Reset time	ANSI DECAYING	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
	t_{res}	$t_{res}, \pm 1\% \text{ or } \pm 20$ ms
Repeatability		$\pm 1\% \text{ or } \pm 20$ ms
Overshoot time		< 40 ms
Disengaging time		< 50 ms

Figure 2-2 shows the operate times for the four IEC IDMTL curves with a time multiplier of 1.

Figures 2-3 and 2-4 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

2.14 51N Time Delayed Derived Earth Fault

2.14.1 Reference

	Parameter	Value
I_s	Setting	0.05, 0.06... 2.5 xI_n
$char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL
T_m	Time Multiplier setting	0.025, 0.05... 1.6
t_d	Delay setting	0, 0.01... 20 s
t_{res}	Reset setting	ANSI DECAIVING, 0, 1... 60 s

2.14.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	105 % I_s , ± 4 % or ± 1 % I_n
	Reset level	≥ 95 % I_{op}
	Repeatability	± 1 %
	Variation	-10 °C to +55 °C
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz
		≤ 5 %
		≤ 5 %

2.14.3 Operate and Reset Time

	Attribute	Value
	Starter operate time ($\geq 2xI_s$)	20 ms, ± 20 ms
t_{op}	Operate time	$char = \text{IEC-NI, IEC-VI, IEC-EI, IEC-LTI}$ $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		$char = \text{ANSI-MI, ANSI-VI, ANSI-EI}$ $t_{op} = \left[\frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	$char = \text{DTL}$	$t_d, \pm 1\% \text{ or } \pm 20\text{ms}$
	Reset time	$ANSI \text{ DECAYING}$ $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
		t_{res}
	Repeatability	$\pm 1\% \text{ or } \pm 20\text{ms}$
	Overshoot time	< 40 ms
	Disengaging time	< 50 ms

Figure 2-2 shows the operate times for the four IEC IDMTL curves with a time multiplier of 1.

Figures 2-3 and 2-4 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

2.15 51SEF Time Delayed Sensitive Earth Fault

2.15.1 Reference

	Parameter	Value	
I_s	Setting	0.005, 0.006...1 x/ I_n	
$char$	Characteristic setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL	
T_m	Time multiplier	1.0	
t_d	Delay setting	0.00...20.00 s	
t_{res}	Reset setting	DECAYING, 0, 1...60 s	
I	Applied current (for operate time)	IDMTL	2 to 20 x/ s
		DTL	5 x/ s

2.15.2 Operate and Reset Level

	Attribute	Value	
I_{op}	Operate level	105 % I_s , $\pm 4\%$ or $\pm 1\%$ I_n	
	Reset level	$\geq 95\%$ $I_{op} \pm 4\%$ or $\pm 1\%$ I_n	
	Repeatability	$\pm 1\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$ harmonics to f_{cutoff}	$\leq 5\%$

2.15.3 Operate and Reset Time

Attribute		Value
Starter operate time		20 ms, $\pm 20ms$
t_{op}	Operate time	char = IEC-NI, IEC-VI, IEC-EI, IEC-LTI $t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^\alpha - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = IEC-NI : K = 0.14, $\alpha = 0.02$ IEC-VI : K = 13.5, $\alpha = 1.0$ IEC-EI : K = 80.0, $\alpha = 2.0$ IEC-LTI : K = 120.0, $\alpha = 1.0$
		char = ANSI-MI, ANSI-VI, ANSI-EI, $t_{op} = \left[\frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \right] \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
	char = DTL	$t_d, \pm 1\% \text{ or } \pm t_{cycle}$
Reset time	char = ANSI and t_{res} = DECAYING $t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \times Tm, \pm 5\% \text{ absolute or } \pm 30 \text{ ms,}$ for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1	
	$t_{res} \neq \text{DECAYING}$	$t_{res}, \pm 1\% \text{ or } \pm 20ms$
Repeatability		$\pm 1\% \text{ or } \pm 20ms$
Overshoot time		< 40 ms
Disengaging time		< 50 ms
Variation	$f_{nom} - 3 \text{ Hz}$ to $f_{nom} + 2 \text{ Hz}$ harmonics to f_{cutoff}	$\leq 5\%$

Figure 2-2 shows the operate times for the four IEC IDMTL curves with a time multiplier of 1.

Figures 2-3 and 2-4 show the ANSI operate and reset curves. These operate times apply to non-directional characteristics. Where directional control is applied then the directional element operate time should be added to give total maximum operating time.

2.16 51V voltage controlled overcurrent (Ph-Ph)

2.16.1 Reference

	Parameter	Value
V_s	Setting	5, 5.5...199.5, 200V
m	multiplier	0.25, 0.3...0.95, 1
I_s	Setting	1xIn

2.16.2 Operate and Reset Level

	Attribute	Value
V_{op}	Operate level	100 % V_s , ± 1 % or $\pm 0.25V$
	Reset level	≤ 105 % V_{op}
	Repeatability	± 1 %
	Variation	-10 °C to +55 °C
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz
		harmonics to f_{cutoff}
		≤ 5 %
		≤ 5 %

Operate and Reset Time

As per Phase Fault Shaped Characteristic Element (ANSI 51).

Where Pickup Level = I_s for Voltage > V_s

Pickup Level = ($I_s \times m$) for Voltage < V_s

2.17 59N Neutral Voltage Displacement

2.17.1 Reference (59NDT)

	Parameter	Value
V_s	Setting	1, 1.5... 100V
t_d	Delay setting	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

2.17.2 Operate and Reset Level (59NDT)

	Attribute	Value
V_{op}	Operate level	100 % V_s , $\pm 2\%$ or $\pm 0.5\text{ V}$
	Reset level	$\geq 95\%$ V_{op} or $\pm 0.25\text{ V}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.17.3 Operate and Reset Time (59NDT)

	Attribute	Value
t_{basic}	Element basic operate time	0V to 1.5 x V_s , 76 ms, $\pm 20\text{ ms}$
		0V to 10 x V_s , 63 ms, $\pm 20\text{ ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 20\text{ ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 50\text{ ms}$

2.17.4 Reference (59NIT)

	Parameter	Value
M	Multiplier setting	0.1, 0.2... 10, 10.5... 140
V_s	Setting	1, 1.5... 100V
t_d	Delay setting	0, 0.01... 20 s
t_{res}	Reset setting	0, 1...60 s

2.17.5 Operate and Reset Level (59NIT)

	Attribute	Value
V_{op}	Operate level	105 % V_s , $\pm 2\%$ or $\pm 0.5\text{ V}$
	Reset level	$\geq 95\%$ V_{op} or $\pm 0.25\text{ V}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.17.6 Operate and Reset Time (59NIT)

	Attribute	Value
t_{basic}	Starter operate time ($\geq 2xV_s$)	65 ms, $\pm 20\text{ ms}$
t_{op}	Operate time	char = IDMTL
		$t_{op} = \frac{M}{\left[\frac{3V_0}{V_s}\right] - 1}$, $\pm 5\%$ or $\pm 65\text{ ms}$
		char = DTL
		t_d , $\pm 1\%$ or $\pm 40\text{ ms}$
	Reset Time	char = IDMTL
		t_{res} , $\pm 5\%$ or $\pm 65\text{ ms}$
		char = DTL
		t_{res} , $\pm 1\%$ or $\pm 40\text{ ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 50\text{ ms}$

2.18 64H Restricted Earth Fault Protection

2.18.1 Reference

	Parameter	Value
I_s	Setting	0.005, 0.006... 0.95 xI_n
t_d	Delay setting	0.00, 0.01... 20.0, 20.1... 100.0, 101....1000, 1010 ... 10000 , 10100 ... 14400 s

2.18.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\% xI_n$
	Reset level	95 % I_{op} , $\pm 5\%$ or $\pm 0.1\% xI_n$
	Repeatability	$\pm 1\%$
	Transient overreach ($X/R \leq 100$)	$\leq -5\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

2.18.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	0 to 2 xI_s , 40 ms, $\pm 10\text{ms}$
		0 to 5 xI_s , 30 ms, $\pm 10\text{ms}$
t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Overshoot time	$< 40\text{ ms}$
	Disengaging time	$< 50\text{ ms}$

2.19 67/67N directional overcurrent & earth fault

2.19.1 Reference

	Parameter	Value
θ_s	Angle setting	-95...+95 °
I	Applied current	I_n
V	Applied voltage	110 V phase-phase (63.5 V phase-earth)

2.19.2 Operate Angle

	Attribute	Value	
CA	Characteristic angle (I with respect to V)	$\theta_s, \pm 5^\circ$	
	Operating angle	forward	$CA - 85^\circ \pm 5^\circ$ to $CA + 85^\circ \pm 5^\circ$
		reverse	$(CA - 180^\circ) - 85^\circ \pm 5^\circ$ to $(CA - 180^\circ) + 85^\circ \pm 5^\circ$
	Variation in characteristic angle	10°C to +55°C	$\pm 5^\circ$
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz	$\pm 5^\circ$

2.19.3 Operate Threshold

	Attribute	Value	
	Minimum levels for operation	I (p/f)	$> 5\% I_n$
		I (e/f)	$> 10\% I_n$
		V (p/f)	> 1 V
		V (e/f)	> 1 V

2.19.4 Operate and Reset Time

	Attribute	Value
	Operate time	typically 32 < 40 ms at characteristic angle
	Reset time	typically < 65 ms at characteristic angle

2.20 81 Under/over frequency

2.20.1 Reference

	Parameter	Value
F_s	Setting	40, 40.01... 69.99 Hz
$Hyst$	Hysteresis setting	0, 0.1... 80%
td	Delay setting	0.00, 0.01... 20.0, 20.1... 100.0, 101....1000, 1010 ... 10000 , 10100 ... 14400 s

2.20.2 Operate and Reset Level

	Attribute	Value
F_{op}	Operate level	100 % F_s , $\pm 10\text{mHz}$
	Reset level	overfrequency (100 % - $hyst$) $\times F_{op}$, $\pm 10\text{mHz}$
		underfrequency (100 % + $hyst$) $\times F_{op}$, $\pm 10\text{mHz}$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C $\leq 5\%$

2.20.3 Operate and Reset Time

	Attribute	Value	
t_{basic}	Element basic operate time (for ROCOF between 0.1 and 5.0 Hz/sec)	overfrequency	Typically < 110ms Maximum < 150ms
		underfrequency	Typically < 110ms Maximum < 150ms
	t_{op}	Operate time following delay	$t_{basic} + t_d$, $\pm 1\%$ or $\pm 10\text{ms}$
		Repeatability	$\pm 1\%$ or $\pm 10\text{ms}$
	Disengaging time	< 100 ms	

Section 3: Supervision Functions

3.1 46BC & 46BC U/C broken conductor

3.1.1 Reference

	Parameter	Value
	Setting (NPS to PPS ratio)	20...100%
	U/C Guard setting	0.05, 0.1 ... 4.95, 5
t_f	Delay setting	0.02...1000 s

3.1.2 Operate and Reset Level

	Attribute	Value
I_{curr}	Operate level	100 % $I_{set} \pm 5 \%$
	Reset level	90 % $I_{curr}, \pm 5 \%$
	Repeatability	$\pm 1 \%$
	Variation	-10 °C to +55 °C $\leq 5 \%$
		$f_{nom} - 3 \text{ Hz to } f_{nom} + 2 \text{ Hz}$ harmonics to f_{cutoff} $\leq 5 \%$

3.1.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Basic operate time 1x In to 0 A	40 ms
	Operate time	$t_f + t_{basic}, \pm 1 \%$ or $\pm 20ms$
	Repeatability	$\pm 1 \%$ or $\pm 20ms$
	Variation	$f_{nom} - 3 \text{ Hz to } f_{nom} + 2 \text{ Hz}$ harmonics to f_{cutoff} $\leq 5 \%$

3.2 50BF & 50BF-I4 circuit breaker fail

3.2.1 Reference

	Parameter	Value
I_s	50BF Setting	0.050, 0.055... 2.0 x I_n
I_s	50BF-I4 Setting	0.005, 0.01... 2.0 x I_n
t_{CBF1}	Stage 1 Delay setting	20, 25... 60000ms
t_{CBF2}	Stage 2 Delay setting	20, 25... 60000ms

3.2.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I_s , $\pm 5\%$ or $\pm 1\% I_n$
I_{reset}	Reset level	$< 100\% I_{op}$, $\pm 5\%$ or $\pm 1\% I_n$
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

3.2.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	$< 20\text{ms}$
t_{op}	Stage 1	t_{CBF1} , $\pm 1\%$ or $\pm 20\text{ms}$
	Stage 2	t_{CBF2} , $\pm 1\%$ or $\pm 20\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ms}$
	Overshoot	$< 2 \times 20\text{ms}$
	Disengaging time	$< 30\text{ms}$

3.3 60CTS & CTS-I Current Transformer Supervision

3.3.1 Reference

	Parameter	Value
I_{thresh}	Current Threshold	0.05, 0.1... 1 xIn
V_{thresh}	Voltage Threshold	7, 8... 110V
t_d	Delay setting	0.03, 0.04...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s
$CTS-I$ I_{thresh}	Current Threshold	0.05, 0.1... 2 xIn

3.3.2 Current & Voltage Threshold

	Attribute	Value	
I_{op}	CT failed current level	100 % I_{thresh} , $\pm 5\%$ or $\pm 1\%$ In	
	Reset level	90 % I_{op} , $\pm 5\%$ or $\pm 1\%$ In	
V_{op}	CT failed voltage level	100 % V_{thresh} , $\pm 2\%$ or $\pm 0.5V$	
	Reset level	110 % V_{op} , $\pm 2\%$ or $\pm 0.5V$	
	Repeatability	$\pm 1\%$	
	Variation	-10 °C to +55 °C	$\leq 5\%$
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$	$\leq 5\%$
		harmonics to f_{cutoff}	

3.3.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Basic operate time	30 ms $\pm 20\text{ms}$
	Operate time	t_{basic} , $\pm 1\%$ or $\pm 20\text{ms}$
	Repeatability	$\pm 1\%$ or $\pm 20\text{ms}$

3.4 60VTS Voltage Transformer Supervision

3.4.1 Reference

	Parameter	Value
V_{nps}	Vnps Level	7, 8 ... 110V
I_{nps}	Inps Level	0.05, 0.1 ... 1 x In
I_{pps}	Ipps Load Level	0.05, 0.1 ... 1 x In
I_{Fpps}	Ipps Fault Level	0.05, 0.1 ... 20 x In
V_{pps}	Vpps Level	1, 2 ... 110V
t_d	60VTS Delay	0.00, 0.01...20.00, 20.50... 100, 101... 1000, 1010... 10000, 10100... 14400 s

3.4.2 Operate and Reset Level

	Attribute	Value
V_{NPSop}	Voltage NPS operate level	100 % V_{nps} , $\pm 5\%$ V_n
	Voltage NPS reset level	90 % V_{NPSop} , $\pm 5\%$ V_n
V_{PPSop}	Voltage PPS operate level	100 % V_{pps} , $\pm 5\%$ V_n
	Voltage PPS reset level	110 % V_{PPSop} , $\pm 5\%$ V_n
I_{NPSblk}	Current NPS operate level	100 % I_{nps} , $\pm 5\%$ xI_n
	Current NPS reset level	90 % I_{NPSblk} , $\pm 5\%$ xI_n
I_{PPSblk}	Current PPS operate level	100 % I_{Fpps} , $\pm 5\%$ xI_n
	Current PPS reset level	90 % I_{PPSblk} , $\pm 5\%$ xI_n
$I_{PPSload}$	Current PPS operate level	100 % I_{pps} , $\pm 5\%$ xI_n
	Current PPS reset level	90 % $I_{PPSload}$, $\pm 5\%$ xI_n
	Repeatability	$\pm 1\%$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3\text{ Hz}$ to $f_{nom} + 2\text{ Hz}$
		$\leq 5\%$
		$\leq 5\%$

3.4.3 Operate and Reset Time

	Attribute		Value
t_{basic}	Basic operate time	0V to 2 x Vs	32 ms \pm 10ms
	Operate time		t_{basic} , \pm 1 % or \pm 10ms
	Repeatability		\pm 1 % or \pm 10ms

3.5 74TCS Trip Circuit Supervision

3.5.1 Reference

	Parameter	Value
t_d	Delay setting	0, 0.02...60 s

3.5.2 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	30ms \pm 10ms
t_{op}	Operate time following delay	$t_{basic} + t_d, \pm 1 \% \text{ or } \pm 10\text{ms}$
	Repeatability	$\pm 1 \% \text{ or } \pm 10\text{ms}$
	Variation	-10 °C to +55 °C
		$f_{nom} - 3 \text{ Hz to } f_{nom} + 2 \text{ Hz}$
		$\leq 5 \%$
		$\leq 5 \%$

3.6 81HBL2 Inrush Detector

3.6.1 Reference

	Parameter	Value
I	Setting (Ratio of 2nd Harmonic current to Fundamental component current)	0.10, 0.11... 0.5

3.6.2 Operate and Reset Level

	Attribute	Value
I_{op}	Operate level	100 % I , ± 4 % or $\pm 1\%$ I_n
	Reset level	100 % I_{op} , ± 4 % or $\pm 1\%$ I_n
	Repeatability	± 1 %
	Variation	-10 °C to +55 °C
		$f_{nom} - 3$ Hz to $f_{nom} + 2$ Hz
		≤ 5 %
		≤ 5 %

3.6.3 Operate and Reset Time

	Attribute	Value
t_{basic}	Element basic operate time	Will pick-up before operation of any protection element due to magnetic inrush
	Reset Time	Will operation until drop-off of any protection element due to magnetic inrush