

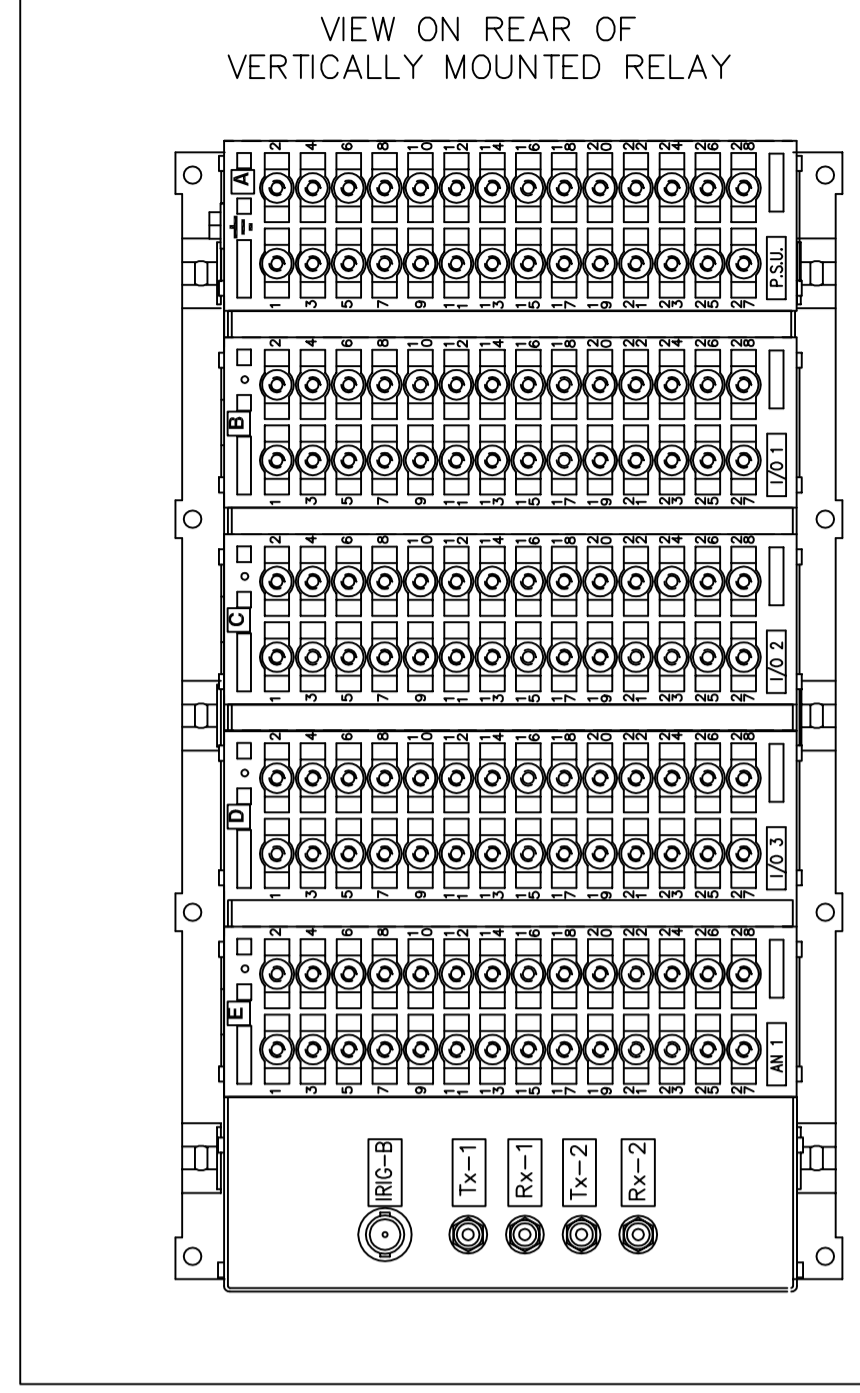


RELAY VIEWED FROM REAR

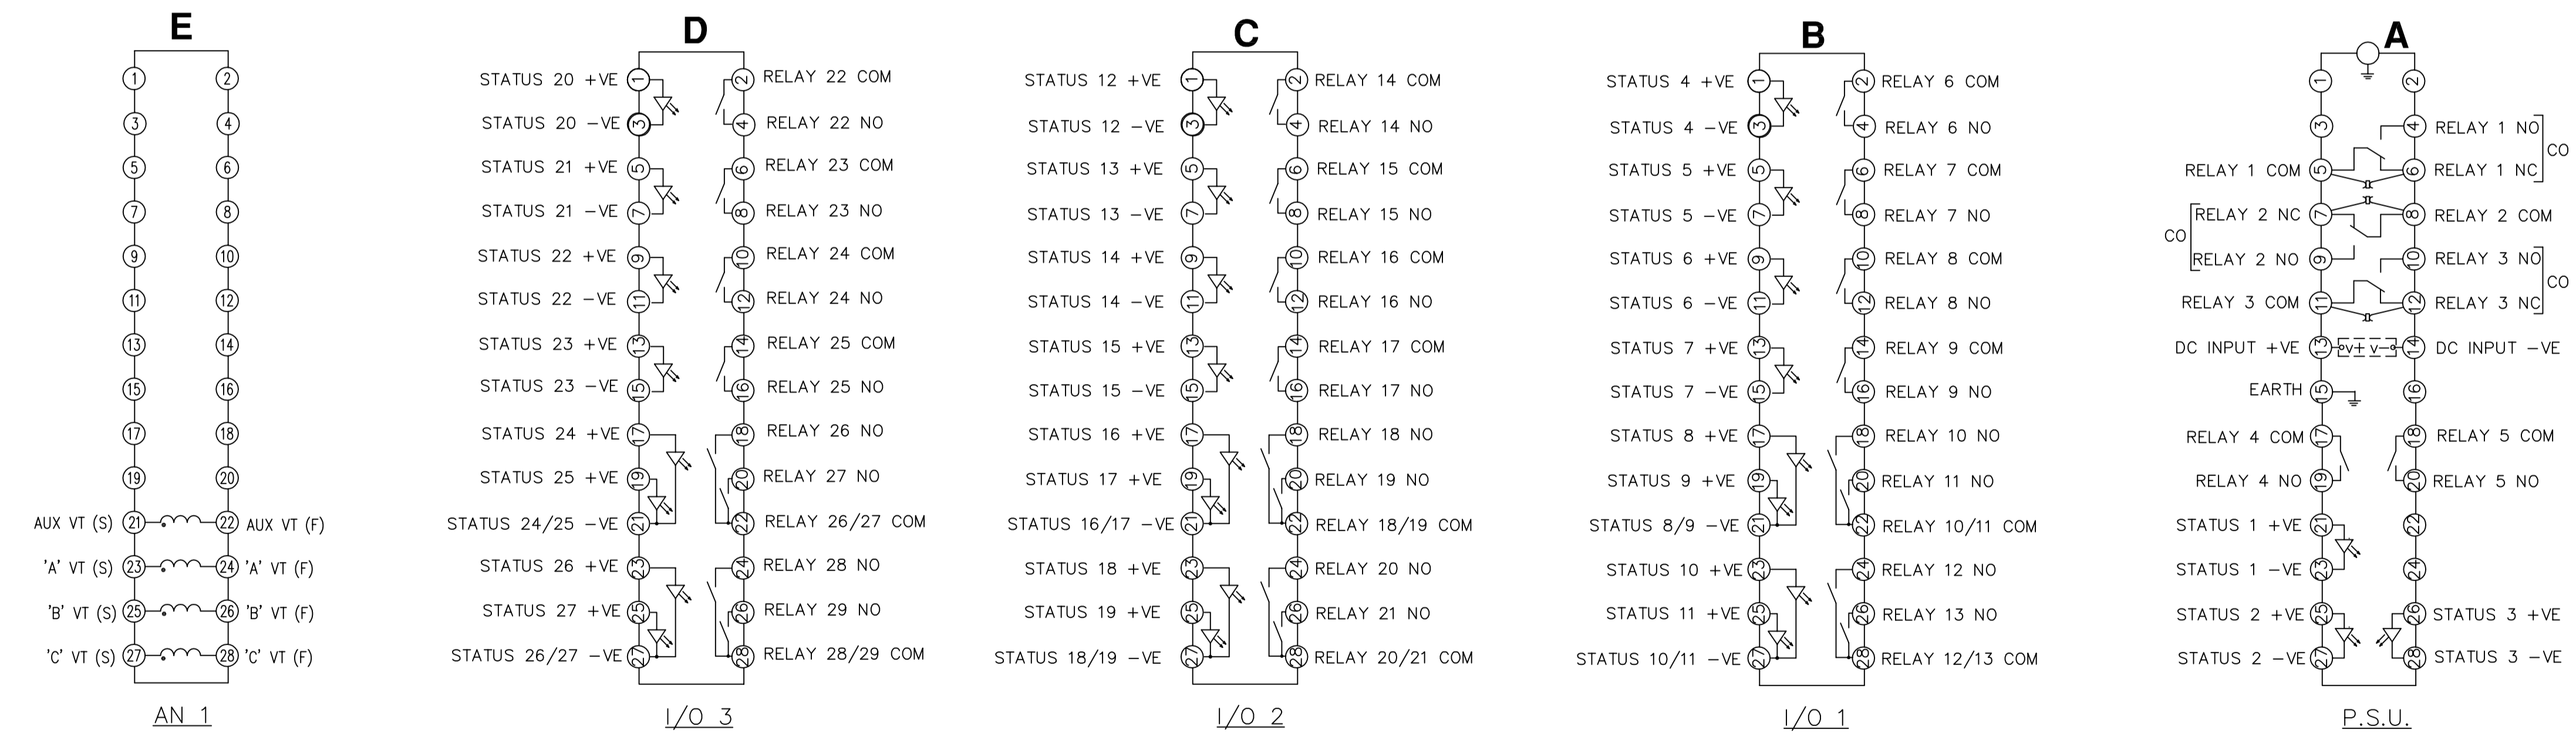

NOTES  
 1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.  
 SUPPLIER AMP 342103 CABLE SIZE 0.25-1.6 SQ MM  
 AMP 342143 1.0-2.6 SQ MM.  
 OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.  
 2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).  
 3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

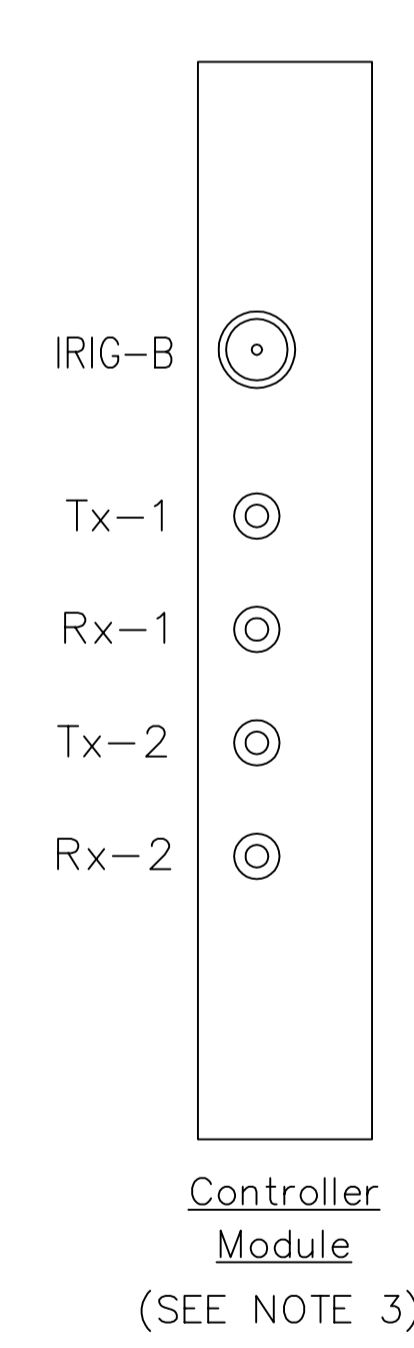

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS	
CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

FOR INFORMATION ONLY  
 UNCONTROLLED COPY  
 NOT SUBJECT TO UPDATE

MATERIAL:  
 Dimensions in millimetres ; Surface texture in micrometres.  
 Machine where marked ✓  
 For explanation of dimensions, tolerances, notes etc. see B.S.308.  
 Limit on untoleranced unmachined dimensions ±  
 Limits on untoleranced machined dimensions to B.S.4500;  
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;  
 over 6 to 30±0.2; over 120 to 315±0.5;  
 General unmachined angular tolerance ±

Finish:	Title:	Copyright © 2005 VATECH REYROLLE ACP Ltd. Hebburn	1st used on:
Treatment:	TERMINAL I.D. & WIRING FOR IOTA COMMON SERVICES RELAY (4VT,27SI,3CO,26NO) E12 CASE.	ISSUE DATE	24/02/05
VATECH REYROLLE AUTOMATION, CONTROL & PROTECTION		Original Scale:	Dr. No.
		NTS	2761W11023
DRAWN MMATHER	CHECKED RDW	APPROVED RD.WATSON	DATE 25/2/05
IE	OPS	PCP	Purch.Spec. TQ
EAC	CE	STD	A1