




RELAY VIEWED FROM REAR

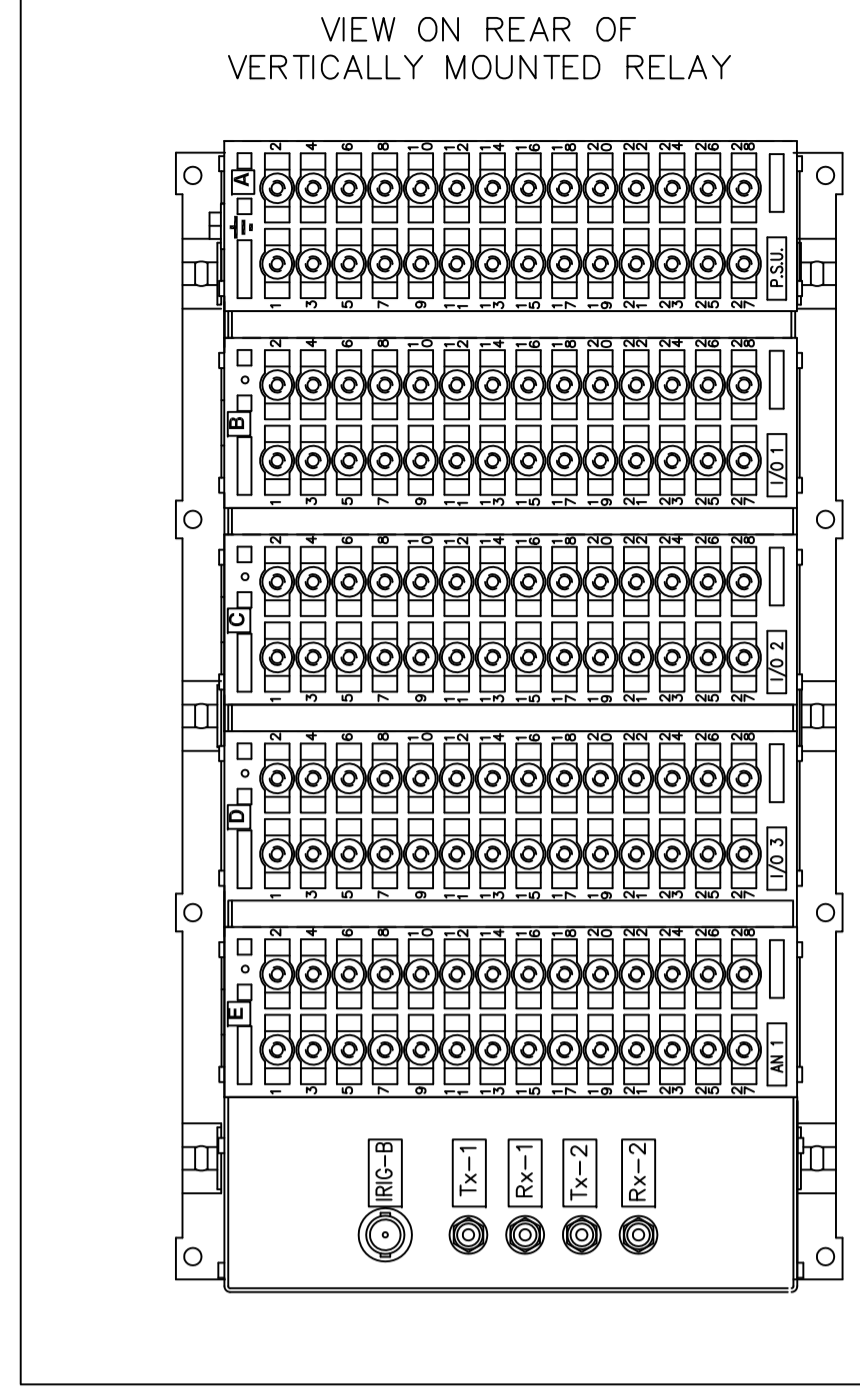

NOTES
 1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.
 SUPPLIER AMP 342103 CABLE SIZE 0.25-1.6 SQ MM
 AMP 342143 1.0-2.6 SQ MM.
 OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.
 2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).
 3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

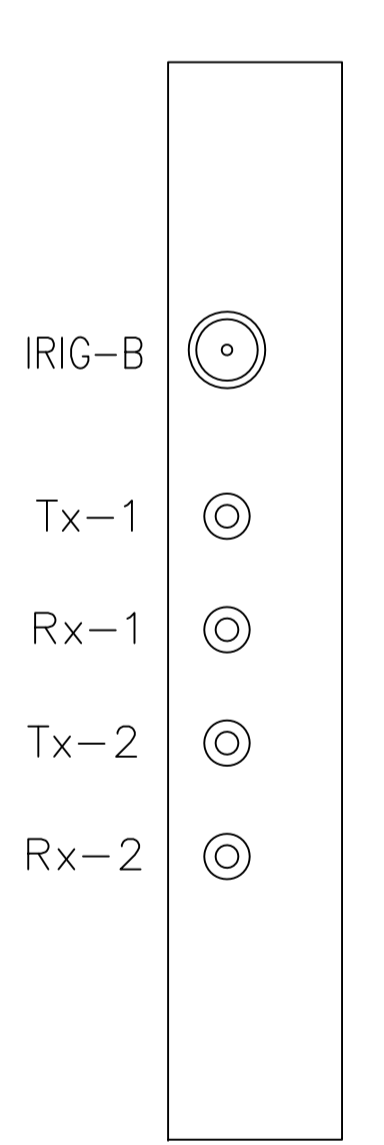

Controller Module
(SEE NOTE 3)

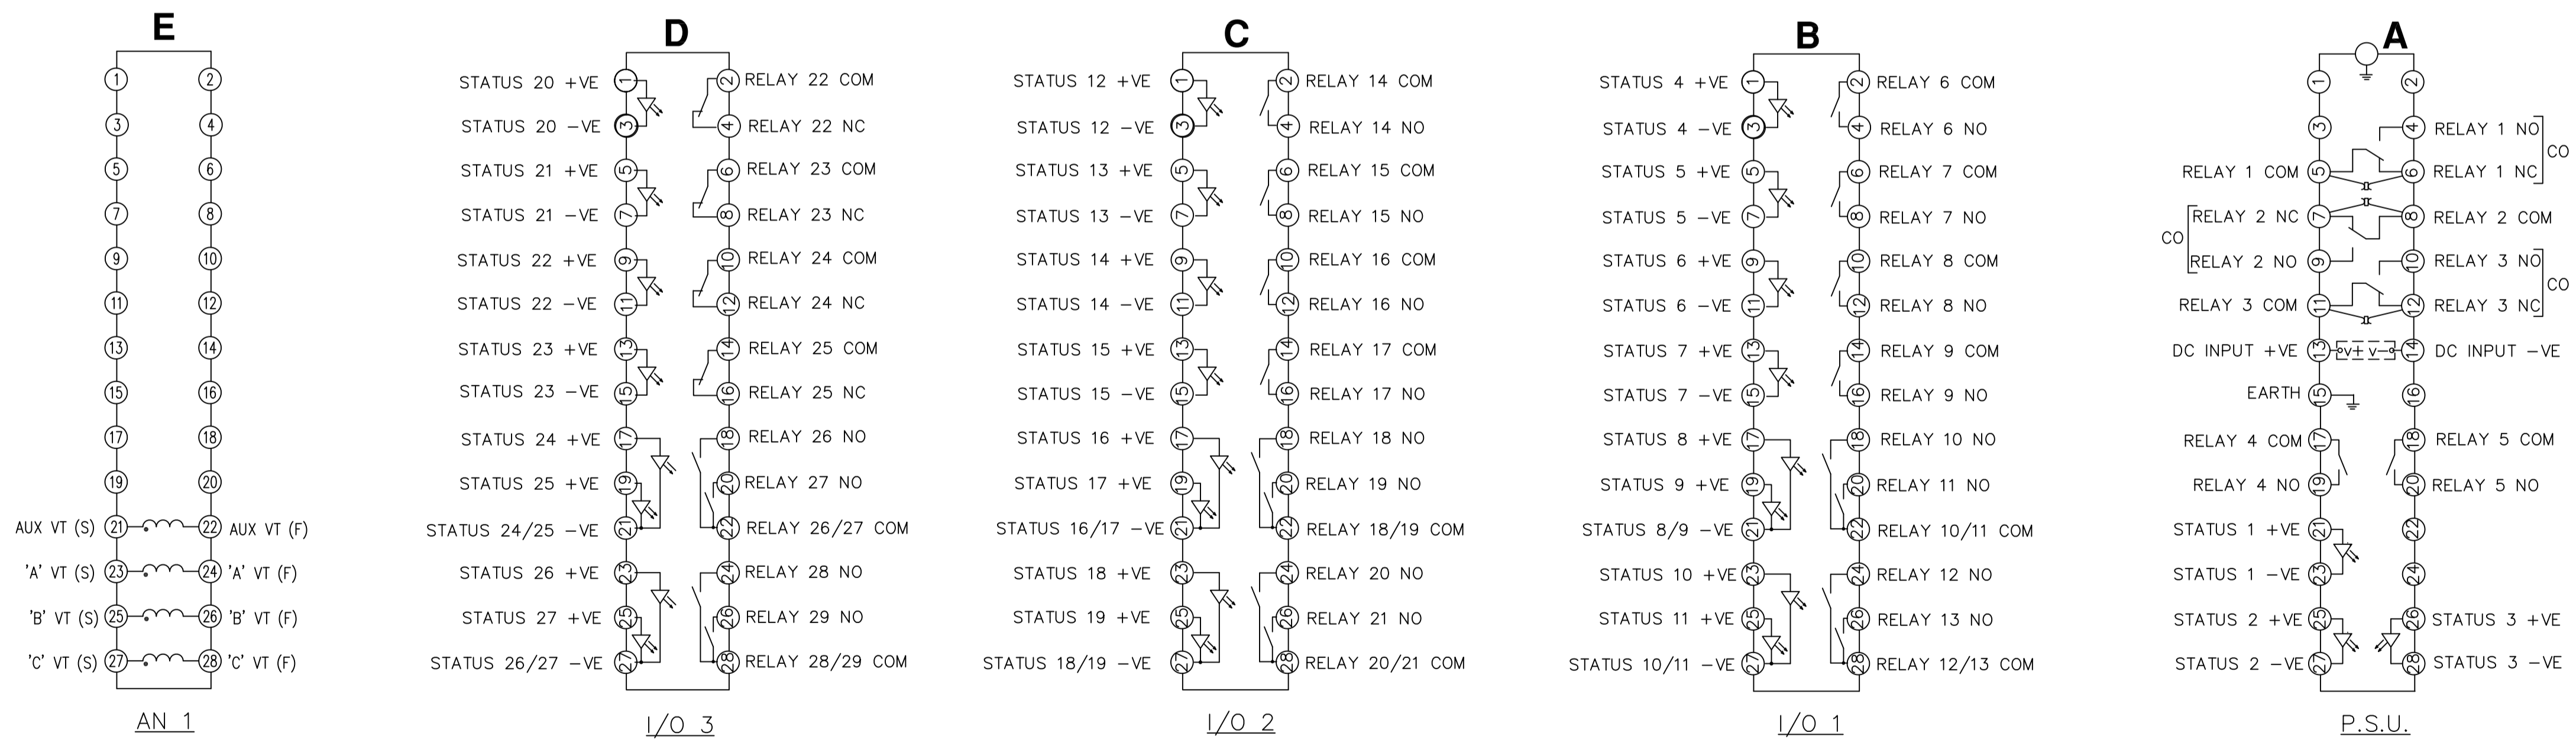

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS	
CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

**NOT SUBJECT TO UPDATE
 ONCE COPIED / PRINTED
 OR DOWNLOADED**

MATERIAL:
 Dimensions in millimetres ; Surface texture in micrometres.
 Machine where marked ✓
 For explanation of dimensions, tolerances, notes etc. see B.S.308.
 Limit on untoleranced unmachined dimensions ±
 Limits on untoleranced machined dimensions to B.S.4500;
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
 over 6 to 30±0.2; over 120 to 315±0.5;
 General unmachined angular tolerance ±

Finish:	Title:	First used on:
Treatment:	TERMINAL I.D. & WIRING FOR IOTA COMMON SERVICES RELAY (4VT,27SI,3CO,22NO,4NC) E12 CASE.	Similar Articles:
VATECH REYROLLE AUTOMATION, CONTROL & PROTECTION		Supersedes:
Original Scale: NTS		Drg. No. 2761W11040

Copyright © 2008 VATECH REYROLLE ACP Ltd. Hebburn

1	20/03/08	CHANGE
ISSUE	DATE	NOTED

DRAWN MM/RDW | CHECKED RDW | APPROVED RD.WATSON | DATE 20/03/08 | IE | OPS | PCP | Purch.Spec. TQ | EAC | CE | STD | A1