

NOTES

1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.



SUPPLIER	AMP	CABLE SIZE
AMP	342103	0.25-1.6 SQ MM
AMP	342143	1.0-2.6 SQ MM.

OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.

2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).

3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

RELAY VIEWED FROM REAR

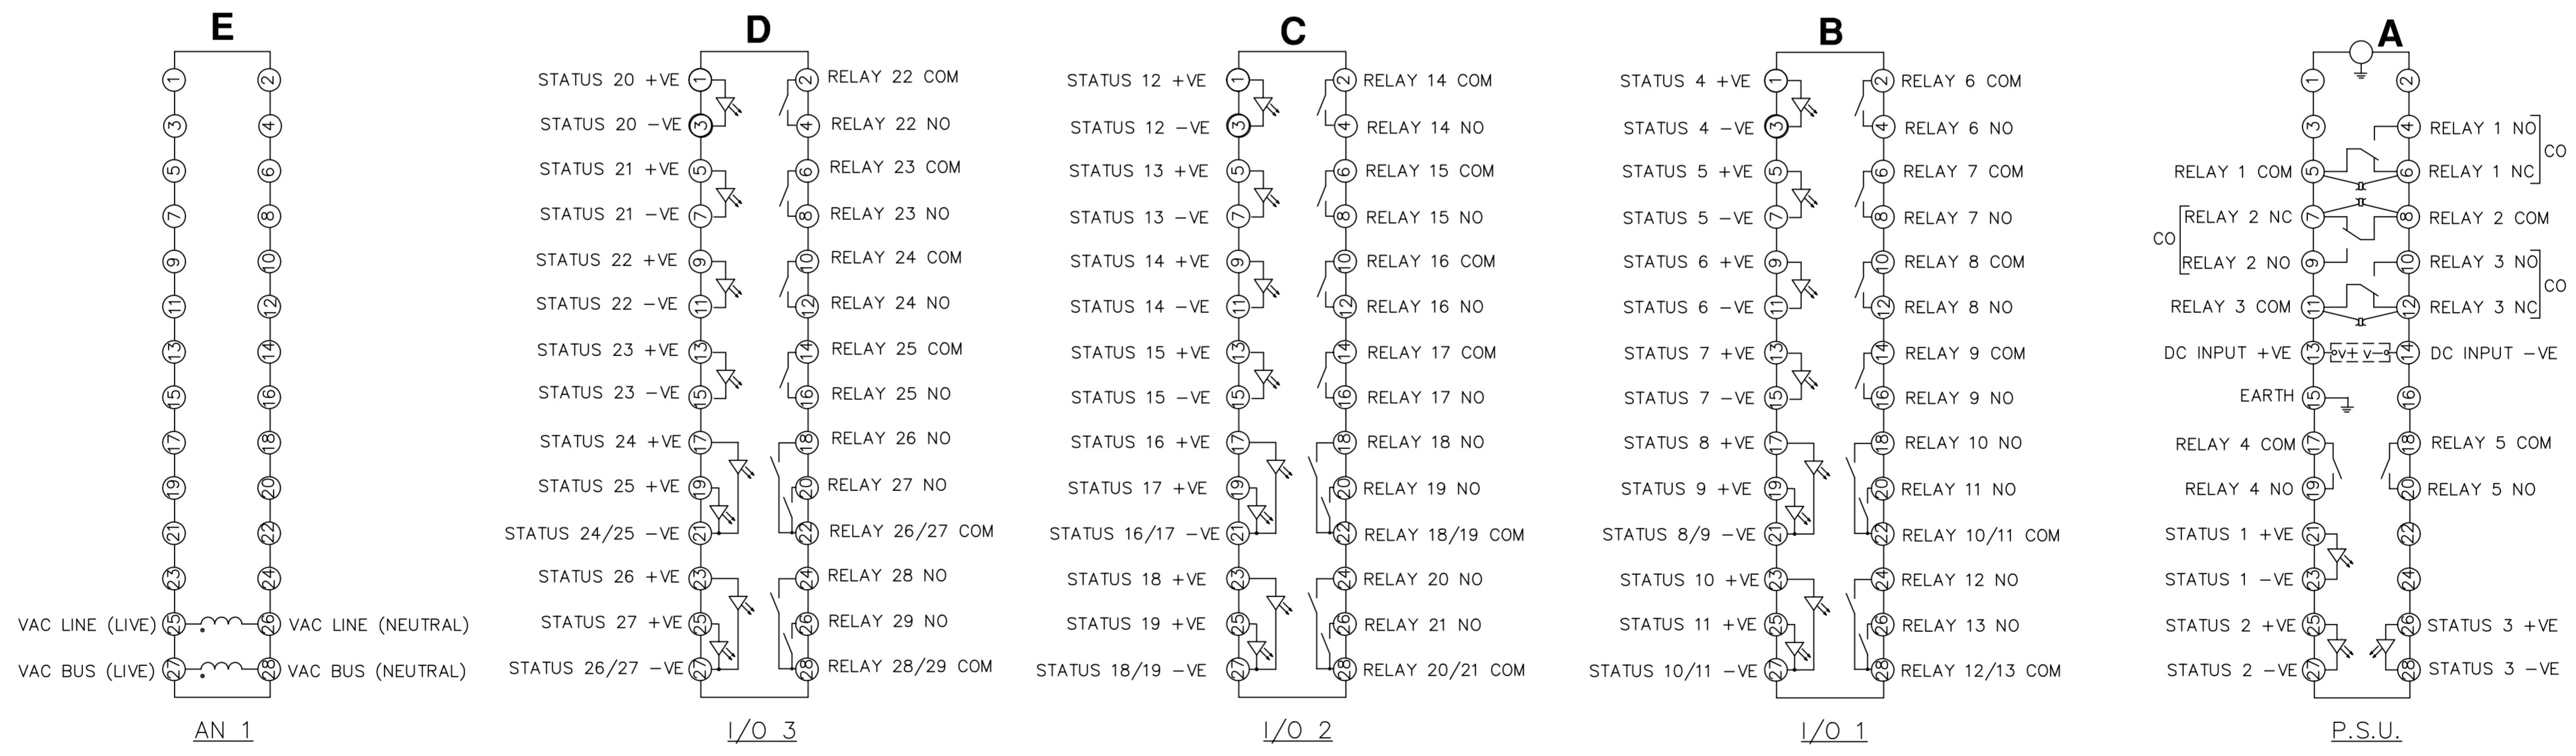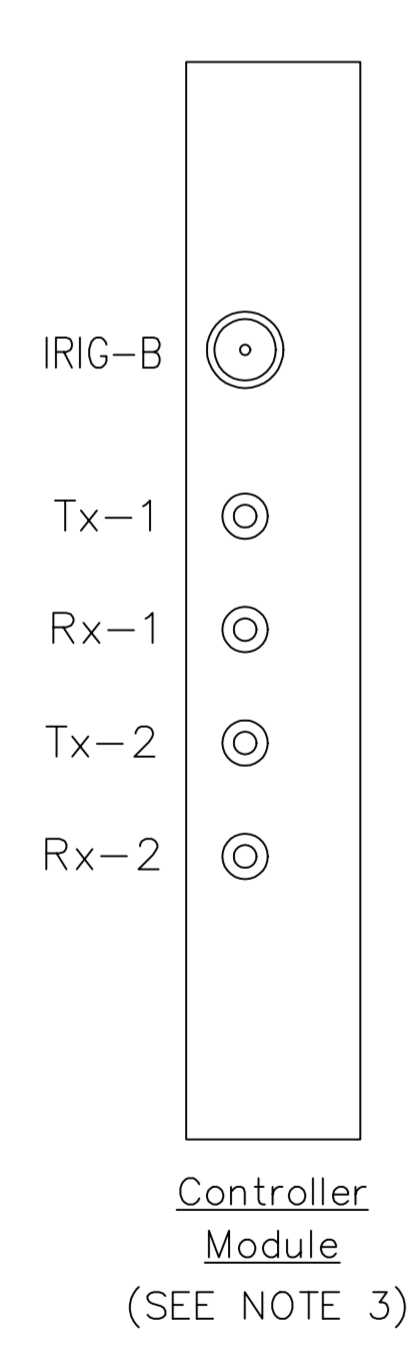

MODULE LABEL KEY

ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS

CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

MATERIAL:

Dimensions in millimetres : Surface texture in micrometres.
Machine where marked ✓
For explanation of dimensions, tolerances, notes etc. see B.S.308.
Limit on untoleranced unmachined dimensions ±
Limits on untoleranced machined dimensions to B.S.4500;
i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
over 6 to 30±0.2; over 120 to 315±0.5;
General unmachined angular tolerance ±

3	RDW	18/08/03	MNS13/240 MM
2		27/8/02	MNS13/2370 RDW
1	ISSUE	20/8/01	CHANGE NOTED

Copyright © 2002 VATECH REYROLLE ACP Ltd. Hebburn

First used on: _____
Similar Articles: _____
Supersedes: _____
Original Scale: _____
Drg. No. **2715W11015**

Drawn: M LEASK | Checked: _____ | Approved: R.D. WATSON | Date: 24/07/02 | IE: _____ | OPS: _____ | PCP: _____ | Purch.Spec.: TQ | EAC: _____ | CE: _____ | STD: _____ | A1: _____

NOT SUBJECT TO UPDATE
ONCE COPIED / PRINTED
OR DOWNLOADED