IF IN DOUBT ASK
DO NOT SCALE

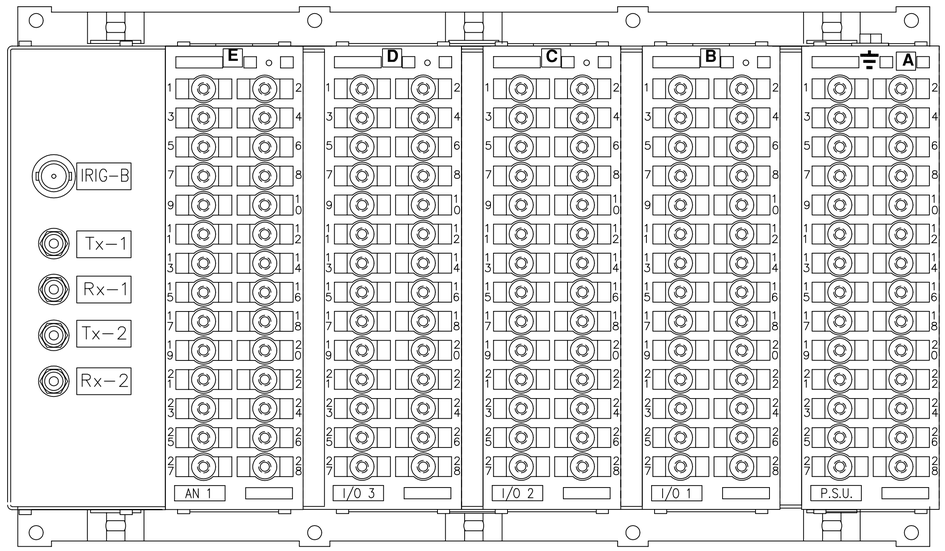

RELAY VIEWED FROM REAR

NOTES

1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING.
AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.

SUPPLIER	AMP	CABLE SIZE
AMP	342103	0.25–1.6 SQ MM
AMP	342143	1.0–2.6 SQ MM.

OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.

2 FOR OUTLINE & DRILLING DRG SEE 2995X10012 (A4).

3 IRIG–B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

VIEW ON REAR OF
VERTICALLY MOUNTED RELAY

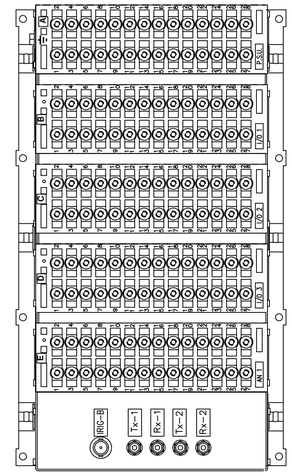

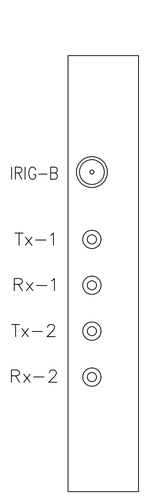

Controller Module
(SEE NOTE 3)

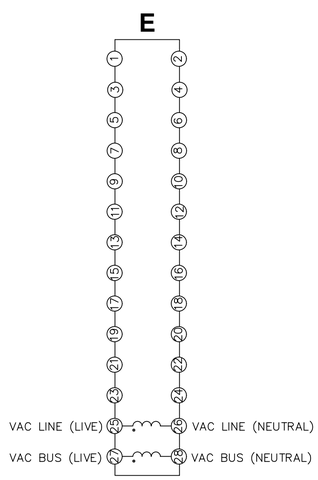

AN 1

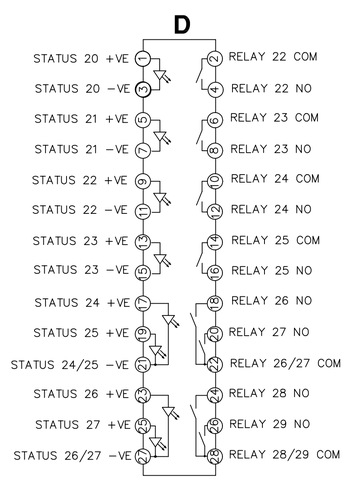

I/O 3

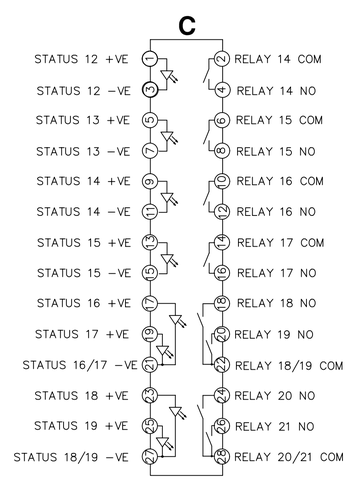

I/O 2

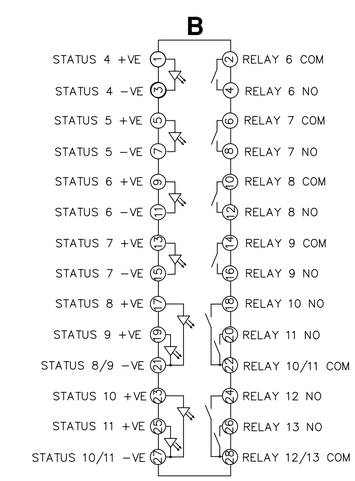

I/O 1

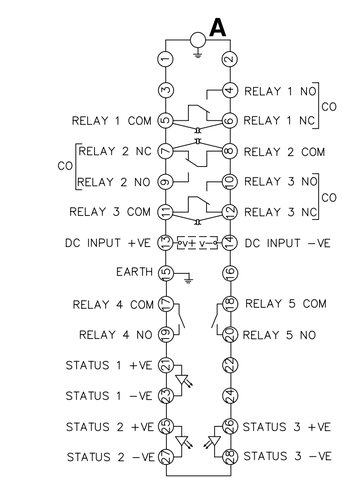

P.S.U.

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS
CT–CURRENT INPUTS
VT–VOLTAGE INPUTS
SI–STATUS INPUTS
CO–CHANGE OVER OUTPUT CONTACTS
NO–NORMALLY OPEN OUTPUT CONTACTS
NC–NORMALLY CLOSED OUTPUT CONTACTS

NOT SUBJECT TO UPDATE ONCE COPIED / PRINTED OR DOWNLOADED

Copyright © 2002 VATECH REYROLLE ACP Ltd. Hebburn

ISSUE	DATE	CHANGE NOTED
3 RDW	18/06/03	MN513/2440 MM
2	27/8/02	MN513/2370 RDW
1	20/8/01	

MATERIAL:

Dimensions in millimetres ; Surface texture in micrometres.
Machine where marked √
For explanation of dimensions, tolerances, notes etc. see B.S.308.
Limit on untoleranced unmachined dimensions ± _____
Limits on untoleranced machined dimensions to B.S.4500;
i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
over 6 to 30±0.2; over 120 to 315±0.5;
General unmachined angular tolerance ± _____

Finish:

Treatment:

Title: TERM IDENT & WIRING DIAGRAM FOR TAU A/R+CHECK SYNC+ DOUBLE ISOLATOR (2VT,27SI,3CO,26NO) E12 CASE

First used on:
Similar Articles:
Supersedes:

VATECH REYROLLE
AUTOMATION, CONTROL & PROTECTION

Original Scale. NTS

Drg. No. 2715W11015

DRAWN M LEASK	CHECKED	APPROVED R.D.WATSON	DATE 24/07/02	IE	OPS	PCP	Purch.Spec.	TQ	EAC	CE	STD	A1

SIEMENS
siemens-russia.com