

NOTES


1 TERMINALS RECOMMENDED ARE PRE INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.

SUPPLIER AMP CABLE SIZE
 AMP 342103 0.25-1.6 SQ MM
 AMP 342143 1.0-2.6 SQ MM.


OR ANY OTHER MANUFACTURERS EQUIVALENT TERMINAL.

2 FOR OUTLINE & DRILLING DRG SEE 2995X10016 (A4).

3 IRIG-B & FIBRE OPTIC CONNECTORS MUST BE DISCONNECTED & FIXING NUTS REMOVED BEFORE WITHDRAWING CONTROLLER MODULE.

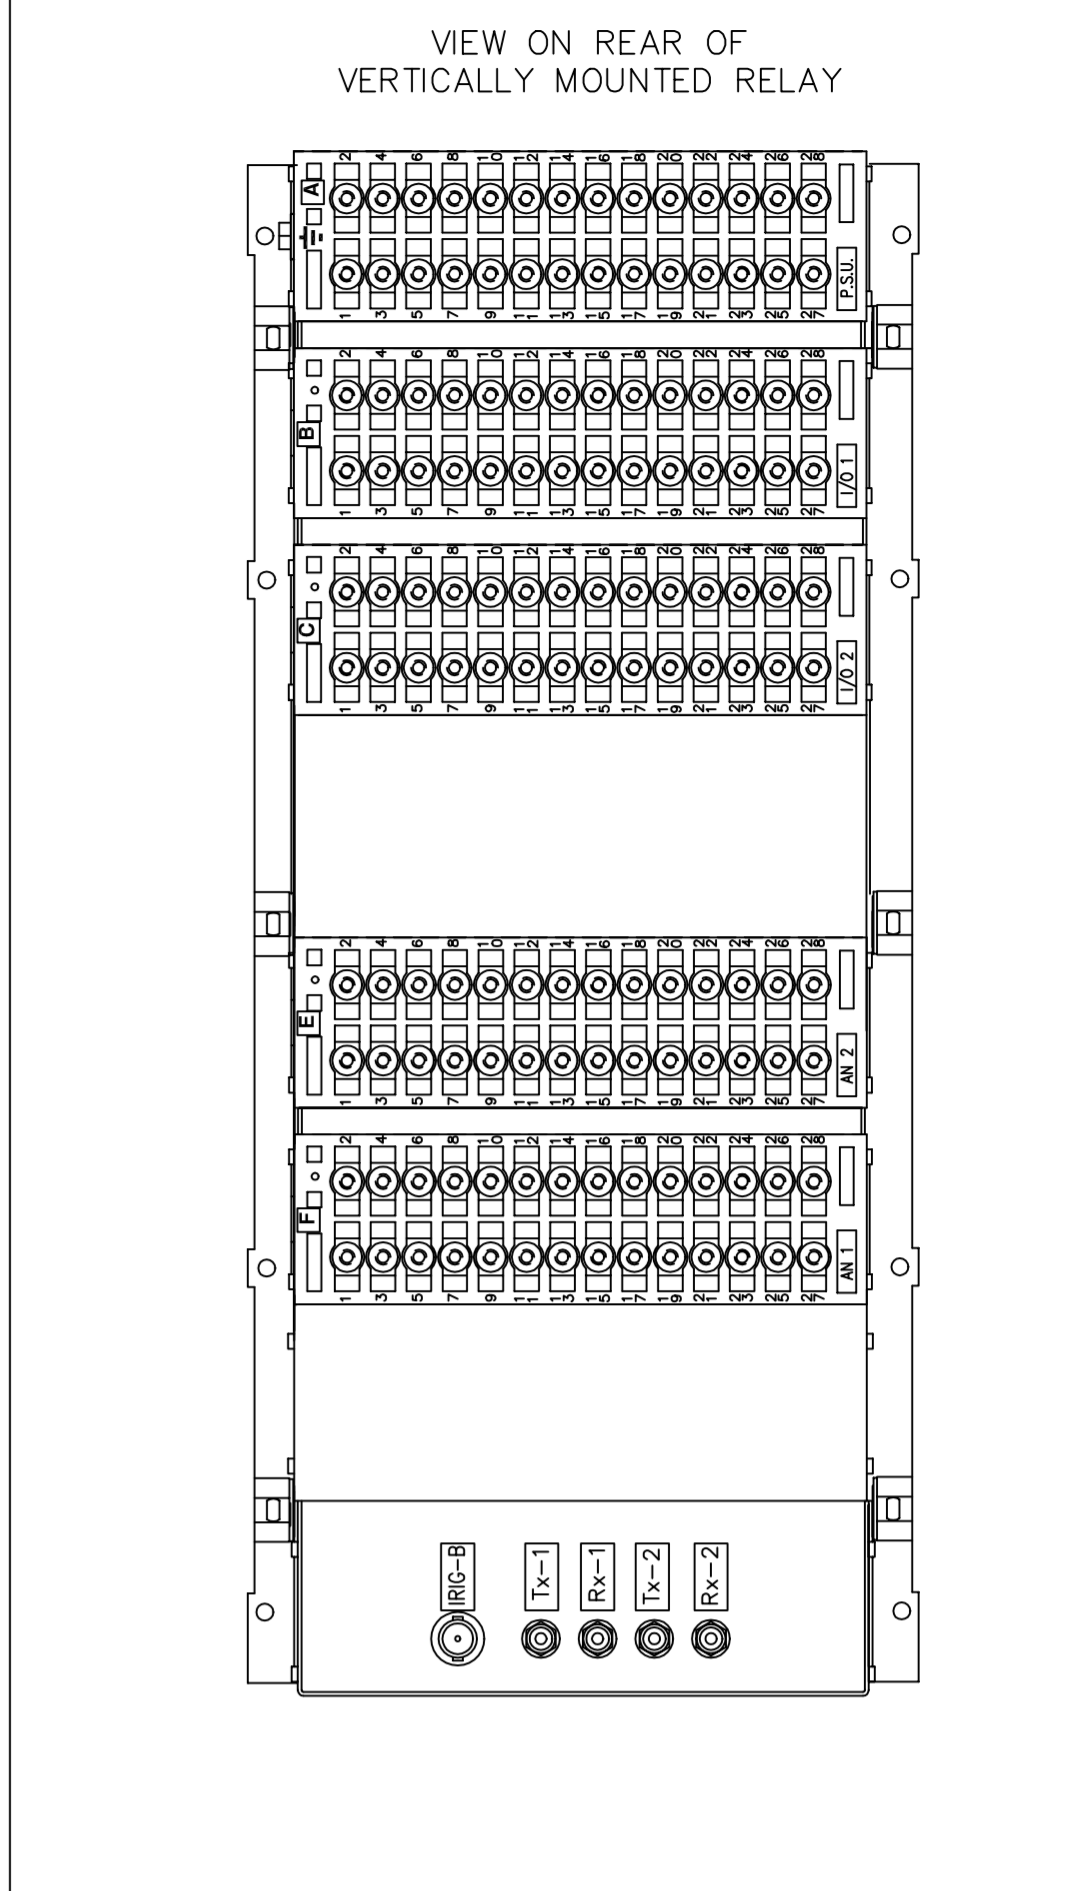

RELAY VIEWED FROM REAR

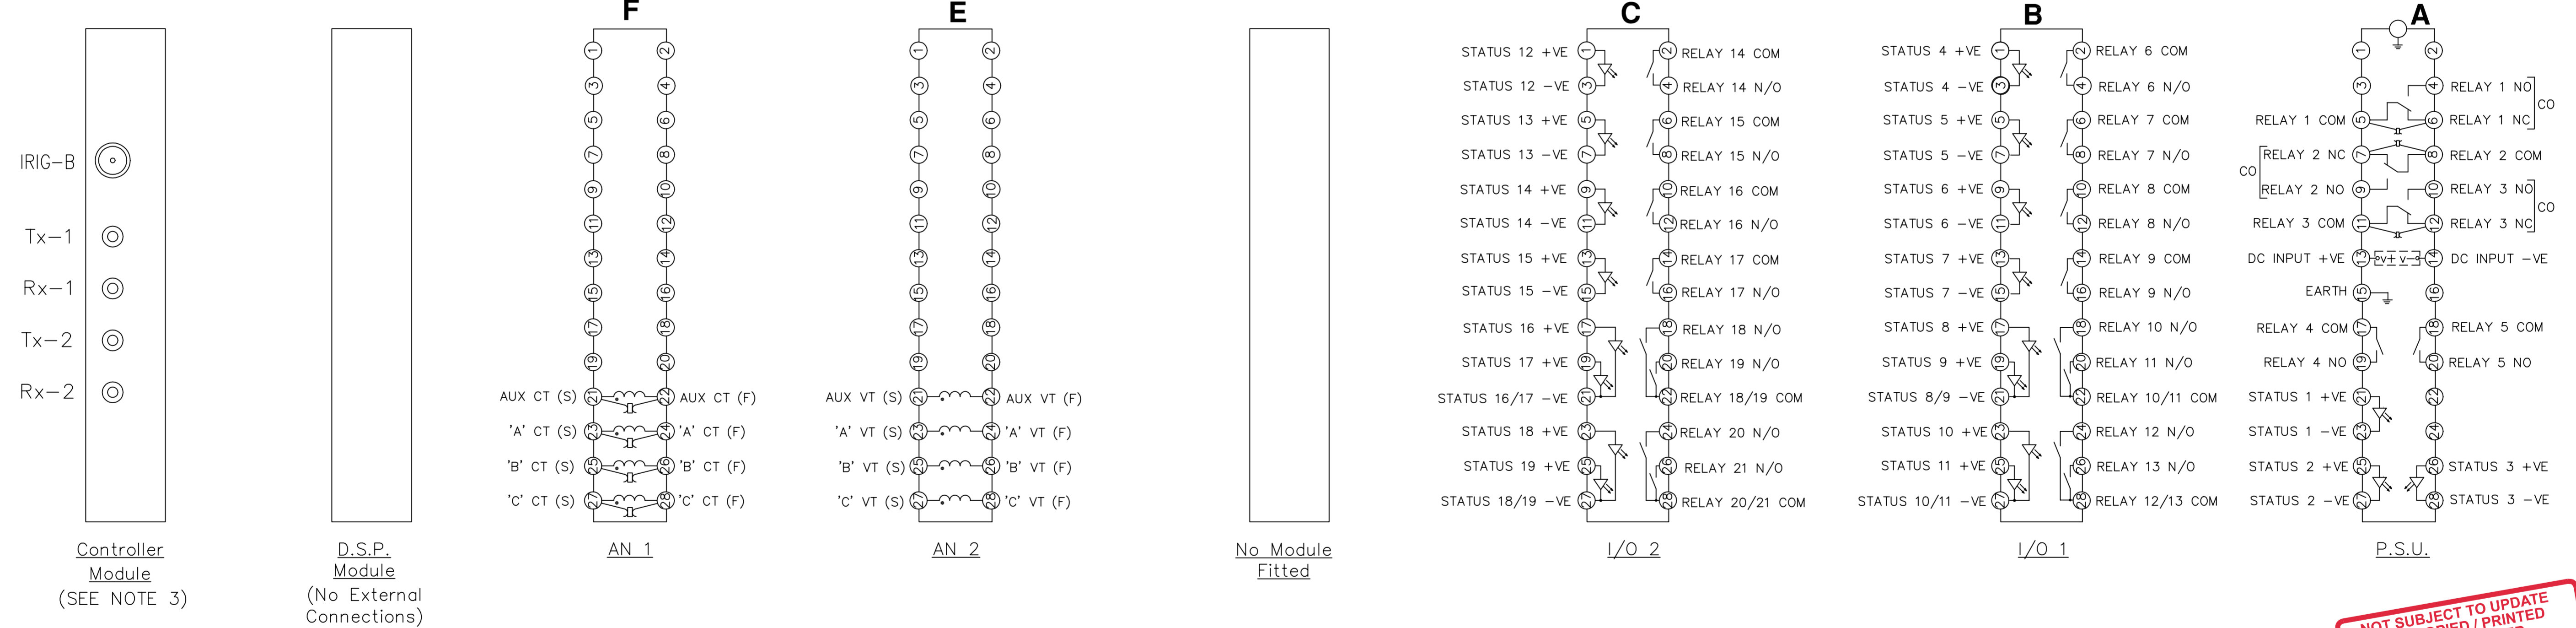

Controller Module (SEE NOTE 3)

D.S.P. Module (No External Connections)

MODULE LABEL KEY	
ANALOGUE MODULE	AN 1 etc
INPUT/OUTPUT MODULE	I/O 1 etc
P.S.U. & BASIC I/O MODULE	P.S.U.

ABBREVIATIONS	
CT	CURRENT INPUTS
VT	VOLTAGE INPUTS
SI	STATUS INPUTS
CO	CHANGE OVER OUTPUT CONTACTS
NO	NORMALLY OPEN OUTPUT CONTACTS
NC	NORMALLY CLOSED OUTPUT CONTACTS

MATERIAL:

Dimensions in millimetres : Surface texture in micrometres.
 Machine where marked √
 For explanation of dimensions, tolerances, notes etc. see B.S.308.
 Limit on untoleranced unmachined dimensions ±
 i.e. up to 6±0.1; over 30 to 120±0.3; over 315±0.8;
 Limits on untoleranced machined dimensions to B.S.4500;
 over 6 to 30±0.2; over 120 to 315±0.5;
 General unmachined angular tolerance ±

Finish:	Title:	First used on:
Treatment:	TERMINAL ID & WIRING FOR OH1-XXX-XC (4CT,4VT,19SI,3CO,18NO) IN E16 CASE.	Similar Articles:
VATECH REYROLLE AUTOMATION, CONTROL & PROTECTION		Supersedes:
Original Scale:	Original Drg. No.	Original Title:
NTS	2615W11007	

NOT SUBJECT TO UPDATE ONCE COPIED / PRINTED OR DOWNLOADED

ROW	DATE	DESCRIPTION
4 ROW	13/08/03	WNS13/2440 MM
3 ROW	21/05/03	WNS13/2440 MM
2	27/02/01	MODULE LABEL & POSTN ADDED MNI1008/279
1	12/10/99	CHANGE
ISSUE	DATE	NOTED